


IPRO 335
GREEN BUILDING DESIGN CONCEPT & INTEGRATION

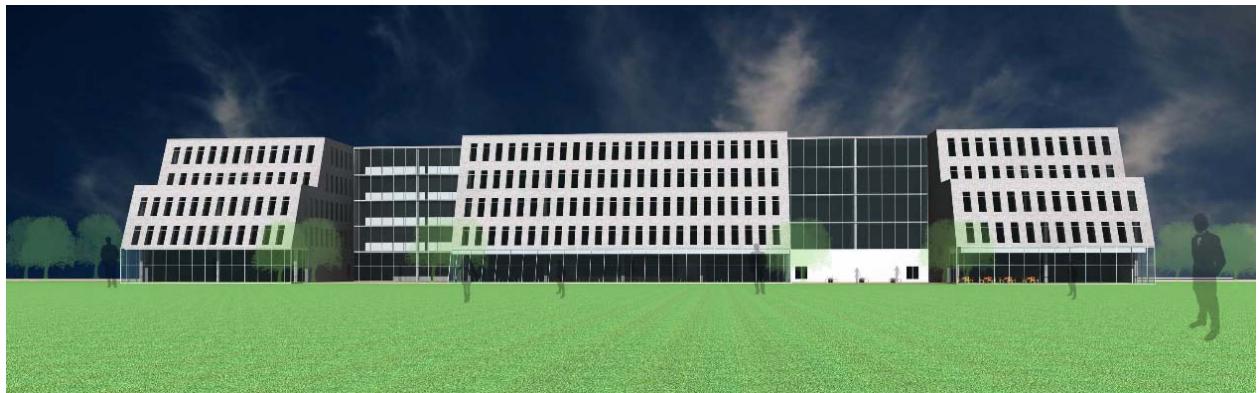

Final Report
December 4th, 2009

Executive Summary

The members of IPRO 335 have taken on the task and successfully completed a preliminary design of a green building which achieves a model for sustainable design and achieves a LEED platinum rating. The building calls for a five story high rise with retail space on the first floor and offices on the upper four floors. Using architectural design methods and increasing the performance of building systems through alternative means of energy, a successful green building design is achieved which is both architecturally appealing and has sound engineering. Through effective communication skills and teamwork, the members of IPRO 335 were able to deliver a realistic preliminary model of green building design concepts and integration.

Purpose:

Green Building design is becoming a vast topic in today's world. As times change, and energy sources become limited and more expensive, we need to find more ways to conserve energy. Green building design is also a way to create a better living and working environment for the occupants while reducing the environmental impact of the building. This IPRO's main goal was to design and implement alternative energy sources into a building in order to obtain LEED Platinum rating while creating a better working environment for its occupants.

Objective:

The objective of the project was to design a five story commercial mixed-use building. The building contains retail stores on the first level, and office spaces on the remaining upper levels. The total foot print area is approximately 49,000 square feet. The building will be constructed with prefabricated columns, beams, floors, and wall panels from The Spancrete Group, Inc. Major sections of the design phase included the use of architectural planning to reduce the building impact as well as the design of major alternative energy systems and water reuse. Also a building energy model that assesses the energy use and the design of structural members to ensure the integrity of the building were incorporated. It was the team's intention to develop an architecturally feasible building schematic which incorporates energy saving features. Using this schematic, research was implemented and the building was designed using as many of the green concepts that are available and functional with respect to the site, practicality, and design knowledge. A goal to have a LEED certified building with a Platinum rating was given to the team members. Finally an estimate of the energy saved, as well as potential money saved through the design is to be provided.

Organization and Approach

The team is divided into two groups among engineers and architects. Amongst the engineers and architects, each person is paired together for a specific research and design phase; an attempt was made to mix and match engineers and architects for more diversity and exchange of ideas. Each team has researched and developed designs for different alternative energy sources or methods used in green building as well as structural and architectural designs; energy systems include: geothermal, solar, wind, and water reuse. Following this, the team has implemented these developments into the design of the building. The architects have created a design that is both suitable and feasible for green methods and allows for maximum LEED points. Within this design, the engineers have incorporated their findings and calculations in order to maximize the potential green building features. Each source of alternative energy or method of green building used will be tested through calculation and research. Even though sub-groups have been made for specific tasks everyone was encouraged and took part in all aspects of the design process. Immense concentration on team work and communication, particularly between the engineer/architect segregation, has been achieved and resulted in positive results for the project. (See Appendix for Team Structure and breakdown)

Analysis and Findings

The following is a breakdown of the main divisions of the project. These divisions consist of structural design, wind energy systems design, geothermal systems design, solar energy systems design, rainwater reuse, architectural design, and a building energy model. A LEED checklist was also put together in order to show that this building design can be LEED platinum certified. These topics were researched and designed in more detail in order to show a building design which is sustainable and practical in today's environment.

Architectural Design

The plan of the building was one that was shaped from the original given footprint of the project, which was very long and narrow. The Architects decided to face one of the longest façades to the south so that the reception of solar light would be the highest. The window area on the south façade was designed to have the optimal amount of natural day lighting enter the building as required by LEED. The windows are punched openings rather than a standard curtain wall to allow for the use of the Spancrete panels for the exterior walls and to increase the insulation value of the building. The building has several step backs which allow for more daylight and space for green roofs. The longitudinal south façade is covered with photovoltaic panels and is designed at an angle to maximize the absorption of sunlight on the panels. Close to the entire area of the roof is used to collect rainwater to supply some areas of the building

with gray water. The other striking feature on the roof is the array of wind turbines, which align with the column grid and create linearity from a distance. The north, east and west façades have fewer openings than the south to keep the building better insulated. (See Appendix for Renderings)

Structural Design

As the architects were completing the final design of the building, the structural group researched design codes referenced in the Chicago Building Code (CBC). Using the CBC, both dead load and live load cases were found for each floor of the building. Research on the sizing of the beams, columns, and floor slabs was done using the D/E (Design and Engineering) handbook provided on the Spancrete website. The website was a useful tool in providing a visual representation of what different sections would look like. After consulting the CBC and the Spancrete design handbook it was decided to design a 1-way flooring system with 40 ft bays. A meeting was scheduled with a Spancrete representative, who was a structural engineer, to help analyze the design and provided information on costs as well as design solutions. After consulting with a Structural Engineer from Spancrete, it was determined that the original design was adequate. However, some changes to the building were made in order to decrease the overall cost. It was decided to replace the beams and columns on the East and West sides of the building with a load bearing wall which will help reduce costs. (See Appendix for design details.)

Wind Energy Systems

The team began this semester researching wind technology and the various types of wind turbines. Wind data available online was gathered to determine the average wind speed for the site. Based on the data collected, the average wind speed for the site was between 3.3 and 4.6 m/s. After some preliminary calculations, assuming the average to be 4 m/s, it was determined that using wind as a main source of energy was not practical with the site conditions and current technology. Despite these facts it was concluded wind energy could still provide a small portion of the energy demand as well as be a highly visible display of the team's desire to build a "green" and efficient building. The next step was to find a turbine that would be able to perform at a high enough level based on site conditions. Vertical axis wind turbines were determined to be the best option and several manufacturers were compared. The final choice was based on the economics of energy production, return on investment period, and visual appearance of the turbine. The final building design features; (11) Urban Green Energy 4 kW vertical axis wind turbines mounted on the roof. These units will have a breakeven point of about 18 years assuming the owner can receive federal and state tax incentives. This system will provide approximately 44,000 kWh/year, which represents about 1% of the buildings

energy demand. The team can also advertise that about 1/3 of the retail lighting is powered by wind energy which will be an incentive for businesses to occupy the building.

Geothermal Systems

The Geothermal System group was in charge of designing a system, which utilizes the earth's core temperature to decrease the energy consumption required to condition the air in the building. The group had to accomplish a wide variety of tasks such as how ground loop geothermal systems function, how to incorporate the system into the building, and basic design of the system to fit our mixed-use building. The group relied heavily on research and case studies, as no members of the IPRO team had experience in geothermal design. Two types of software to help with the design were found and utilized. Ground Loop Design 2009 was used to derive a basic geothermal design. The second piece of software that was incorporated was System Analyzer by Trane; it was used to calculate the heating and cooling loads for a building based on several factors including building occupancy and duration of occupancy, location and climate, building materials and enclosure, and preliminary system information. Through research, analysis of case studies, and use of the aforementioned software, the group was able to design a basic system which uses Florida Heat Pumps model ES 070. Each unit has a cooling capacity of 5221.2 kBtu/hr and a heating capacity of 5029.4 kBtu/hr, where the entire building would use a total of 76 units distributed throughout. The piping for the system would consist of 288 boreholes with a 20 foot spacing, which was consistent with case studies of similar buildings in similar climates. A Long term financial analysis showed that it would take less than a year to pay off the system, making financial sense as well as making the building greener. (See Appendix for data)

Photovoltaic Systems

The photovoltaic system group was responsible for designing a photovoltaic system which will supplement the energy systems already in place, and lessen the amount of power that will have to be pulled from the grid. The architecture on the south façade was manipulated in order to provide optimal natural light to the interior, while also providing optimal proportions of surface area on which to apply the photovoltaic panels. The Sunmodule 230 was chosen as the panel type to be used after comparison amongst other models and manufacturers. This product provides the highest amount of power generated per panel, which is available on the market. In order to find the power produced from the watt peak (Wp) power a PV solar radiation graph assumed to have a flat plate tilted southwards was referred to and provided by the National Renewable Energy Laboratory, a government organization. Using the average annual Insolation in the Chicago land area from the graph, $4.5 \text{ W/m}^2/\text{day}$, it used to find the approximate percentage of 1000 W/m^2 that was actually hitting the plate under Standard Test Conditions (STC), which came out to be 18.75%. With this number the actual kWh of solar collection in the Chicago land area could be calculated in order to find the amount of energy being produced. With 1125 PV panels rated at 230Wp (Watts-peak) on the south

façade and producing 377.8 kWh of power per panel annually; the panels are capable of creating approximately 425,000 kWh of power annually. The cost is approximately \$892,000 for the panels, not including installation, but there are government incentives available that will reimburse the owner for 30% of overall costs not including the savings on electric bills. (See Appendix for graphs and calculations)

Rainwater Harvesting System

Rainwater harvesting is a technology used to collect, convey and store rain from relatively clean surfaces such as a roof for later use. This is water that would otherwise have gone down the drainage system or into the ground. The water is generally stored in a rainwater tank or directed into mechanisms that can recharge groundwater. Rainwater harvesting can provide water for human consumption, reduce water bills and lessen the need to build reservoirs which may require the use of valuable land. Rainwater harvesting in urban areas and cities can have diverse benefits. Providing supplemental water for the city's requirements, increasing soil moisture levels for urban greenery, increasing the ground water table through artificial recharge, mitigating urban flooding and improving the quality of groundwater are a few of the many benefits. The goal is to reuse the collected rainwater for flushing toilets throughout the building. In order to find how much could be collected the average annual rainfall in the Chicago land area was first to be determined which came out to be 38.01 in/year. The next step was to determine the amount of space available on the site that would be used to collect rainwater. From this information it was determined that the building saves 430,800 gallons of rainwater every year which is saving 11.82% of flushing water by adopting a rainwater harvesting system.

Building Energy Model

For the building energy model two models were analyzed. One was a standard building which met the basic requirements of ASHRAE 90.1-2007 and the other was the new energy efficient design. The energy simulation tool used to analyze the building was eQuest v.3.63. This is a free tool which can be downloaded from the Department of Energy website and proved more than adequate in providing simulation results and comparisons. Compared to other programs tested this was the only one where the actual building footprint could be used rather than assuming a shoebox design like other programs, thus giving the team a more accurate representation of the buildings energy consumption. For the standard building, which was compared to the energy efficient model, in order to gain LEED points it must comply with the baseline ASHRAE 90.1-2007 code. Because 90.1 was unavailable to the IPRO group due to time and financial constraints, COMcheck 3.6.1 was downloaded for free from the department of Energy's website. Using COMCheck a basic building envelope was designed which met ASRAE's standards. COMCheck then calculated if the code was met and how much it exceeded the

standards, which was +1%. From this it was determined that the standard building model does indeed meet the required minimum of ASHRAE 90.1-2007 and could be compared to the energy efficient model in order to determine energy saved and meet LEED's criteria for gaining points. Overall the building used a total of 33 percent less energy compared to a standard construction building without the use of alternative energy resources. (Comparison charts can be seen in the Appendix)

LEED Certification

The goal from the beginning was to gain LEED platinum certification for the building since LEED is slowly becoming the industry standard for green efficient design. Throughout the design phase this was kept in mind and reasonable assumptions were made in places where there was not an adequate amount of time to do further research to ensure points. In order to acquire LEED certification the handbook was referenced, which was available online, and a downloadable checklist of current standards was also downloaded for free online. Using results from the energy model as well as power generated through PV and wind energy, points that made up the majority of the points earned were awarded without a doubt and evidence through data to back it up. After reasonable assumptions were made for the remainder of the points the buildings point total came out to 82 points, which meets the requirement of 80+ points for LEED Platinum rating. (See Appendix for checklist)

Conclusions

The IPRO 335 group has spent the good part of the semester putting together a building design that is both architecturally appealing and meets the standards of a green building which can feasibly be LEED Platinum certified. The architectural façade allows for maximum penetration of sunlight as well as an optimum angle for the photovoltaic panels to be mounted on in order to collect the most sunlight. The PV panels selected and mounted will be able to collect enough energy to supplement 10 percent of the buildings energy use. Heat pumps were also selected as a source of energy for the HVAC system which drastically reduces the amount of energy used in a standard system as well as the amount of natural gas that would be consumed for heating otherwise. The wind turbines mounted on the building not only provide a statement of green but also add an additional 1 percent reduction in energy consumption of the building. Using an energy model it was calculated that all the energy saved and produced lead to an overall energy reduction of the building of 42 percent, which will save the owner money in the long run as well as reduce the environmental impact of the building. In order to show that this would be a feasible design it was the intention of the IPRO team not to select all the most expensive materials which would provide the best insulation money could buy. Rather middle of the line materials was selected and an emphasis on alternative sources of energy which can pay themselves off within the lifetime of the building was used in order to provide a feasible model for all future new construction.

Appendix

Team Structure:

- Groups: Two main sub-groups formed within the team

| Architects | Engineers |
|--------------------------------------|-------------------------------|
| Eric Dexter | Aris Avanessian (Team Leader) |
| Adrian Thovar Leon | Andrew Mey |
| Jacqueline Schaefer (Head Architect) | Jonathon Okunaga |
| Justine Banda | Ali Razeq (Project Engineer) |
| Kibum Kim | Joshua Bergerson |
| Hye Um | |
| Jeffrey Burke | |
| Robert Christo | |

- Research and Design Groups: Pairs of team members formed to do research and complete the design and integration of different building aspects.

| Team Members | Topic of Research |
|--|------------------------------|
| Ali Razeq & Eric Dexter | Geothermal Systems |
| Andrew Mey & Adrian Leon | Wind Turbines |
| Jacqueline Schaefer & Justine Banda | Solar Heat Collection |
| Kibum Kim & Hye Um | Reusing Rain and Brown Water |
| Jon Okunaga & Joshua Bergerson | Structural design |
| Jeffrey Burke and Robert Christo | Building Model (AutoCAD) |
| Aris Avanessian | Building Energy Model |
| Andrew Mey & Ali Razeq | LEED Checklist |


- Major Tasks: Design considerations kept in mind by respective fields

| Project Task | Assigned Sub-Group |
|---|--------------------|
| Site Selection and Layout | Architects |
| Building Architecture/Designs | Architects |
| Detail Drawings | Architects |
| Selection of Type of Structure (steel or concrete) | Both |
| Green Building concepts | Both |
| Structural Analysis & Structural Design | Both |
| Building Comfort (Heating/Cooling) | Engineers |
| Electrical System | Engineers |
| Lighting System | Engineers |
| Acoustics | Engineers |
| Estimate of Building Cost | Engineers |


Architectural Renderings:



Northwest ground view

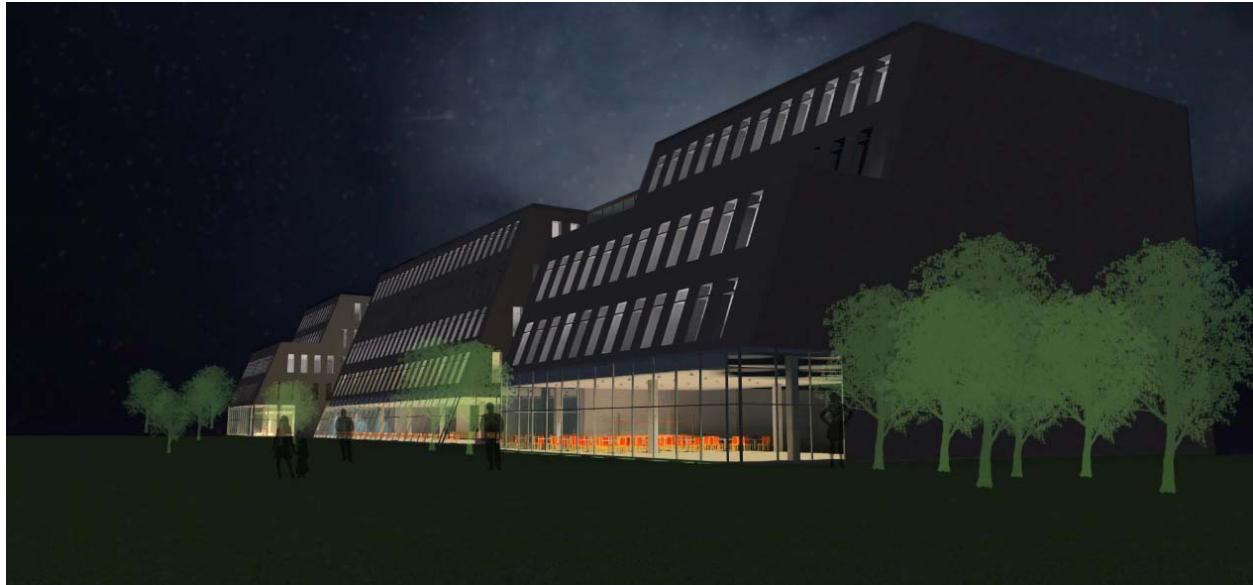

Night Rendering Northwest

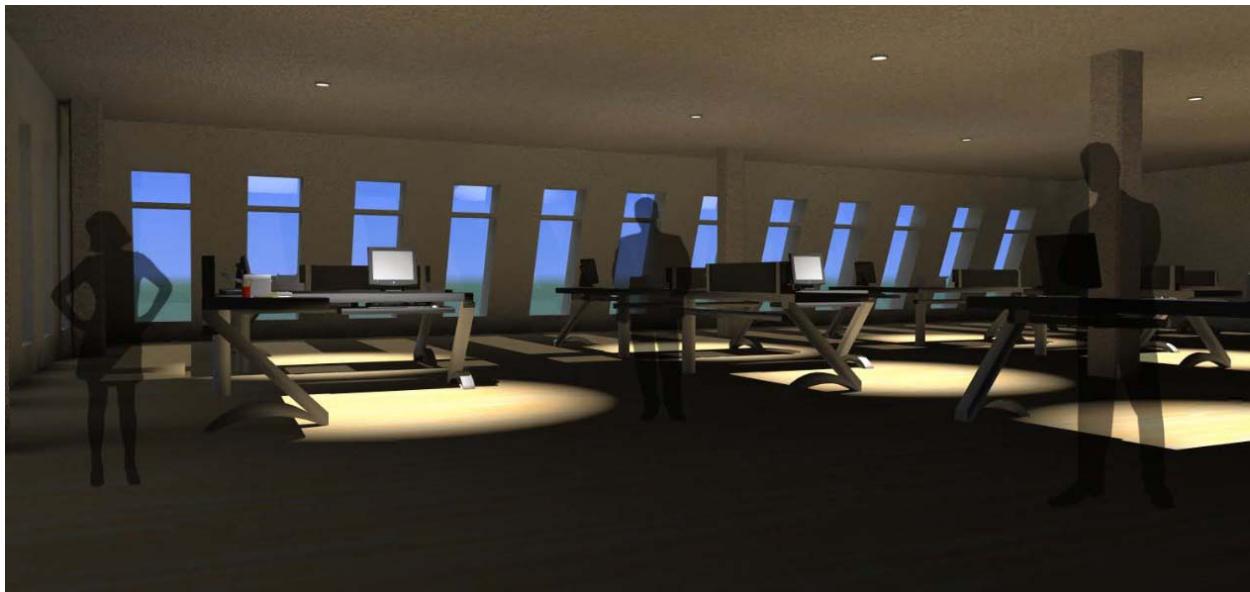

Interior Office View



Interior Café View

Structural Data:

Chicago Building Code Considerations

Structural Analysis of Building

Uniform Live Loads:

| | |
|--------------------|---------|
| ROOF | 25 PSF |
| OFFICE | 50 PSF |
| CORRIDORS | 100 PSF |
| LOBBY/ FIRST FLOOR | 100 PSF |
| RETAIL | 100 PSF |

Partition Loads:

- Partition loading of at least 20psf, unless live load is greater than 80psf
- Partition loading to be treated as a dead uniform loading on columns

Concentrated Loads:

- The following concentrated loads are assumed distributed over an area of 2.5sq ft (unless otherwise noted), located such as to produce the greatest stress in a member or system

| Location | Load (lbf) |
|---|------------|
| Elevator machine room grating (area of 4 sq in) | 300 |
| Office Floors | 2000 |
| Sidewalks | 8000 |
| Stair treads (area of 4 sq in on center of tread) | 300 |
| Porch, deck and balcony (area of 4 sq in) | 300 |

Roof Loads:

Minimal Loading:

- Roofs shall have a live loading of at least 15 psf

Environmental:

- Environmental loads are not to be reduced by live load reductions
 1. Rain
 - For roof with roof drain heads described in Section 29(13-168-640) shall have loading of 25psf, 3 inch max ponding
 - For roof with roof drains for controlled flow as described in Section 29(13-168-650) shall have loading of 35psf, 6 inch max ponding
 2. Snow
 - Flat roof (slope less than 1 in/ft) to have live load of 25psf.
 - Unbalanced loads??? (half loading)

Lateral Loads:

| Height (ft) | Min. wind force resisting system wind pressure (psf) | Components and Cladding wind pressure, other than corner (psf) | Components and Cladding wind pressure, at corner (psf) |
|----------------|--|--|--|
| 200 FT OR LESS | 20 | 25 | 30 |

- The pressure specified for components and cladding at corner shall apply over a distance of 10% least building width or .5 height above grade, whichever is smaller.
 - For our building, $.5 \times 75 \text{ ft} = 37.5 \text{ ft}$ or $.1 \times 120 \text{ ft} = 12 \text{ ft}$; therefore, apply for 12 ft from corners.
- The pressures act in any direction and represent positive or negative pressures.
 - Flat Roofs
 - Outward pressure of 75% of min. wind force resisting system wind pressure for the roof height and applied over the entire roof area.

Precast SPANCRETE Beam Member Loads and Sizes

A. LOADINGS:

1. Dead Loads:

a. Roof:

| | |
|--------------------------------------|---------------|
| 8" PRESTRESSED HOLLOWCORE FLOOR SLAB | 60 PSF |
| WATER COLLECTION SYSTEM | 3 PSF |
| 2" RIGID INSULATION | 2 PSF |
| MECHANICAL MISC. | 4 PSF |
| Total | 69 PSF |

b. Typical Interior:

| | |
|---------------------------------------|------------------|
| 12" PRESTRESSED HOLLOWCORE FLOOR SLAB | 90 PSF |
| SUSPENDED CEILING | 2.5 PSF |
| ELCTRICAL HVAC | 5.5 PSF |
| PLUMBING | 2 PSF |
| INTERIOR COLUMNS | 5.5 PSF |
| MISC. | 1.1 PSF |
| Total | 106.6 PSF |

c. Typical Exterior:

| | |
|---------------------------------------|---------|
| 12" PRESTRESSED HOLLOWCORE FLOOR SLAB | 90 PSF |
| SUSPENDED CEILING | 2.5 PSF |
| ELCTRICAL HVAC | 5.5 PSF |
| PLUMBING | 2 PSF |
| EXTERIOR MOMENT COLUMNS | 11 PSF |

| | |
|-------|-----------|
| MISC | 1.1 PSF |
| Total | 112.1 PSF |

2. Live Loads:

| | |
|--------------------|---------|
| ROOF | 25 PSF |
| OFFICE | 50 PSF |
| CORRIDORS | 100 PSF |
| LOBBY/ FIRST FLOOR | 100 PSF |

TRIBUTARY WIDTH= 40FT

FOR TYPICAL BEAMS FLOORS 2-5, TOTAL SUPERIMPOSED LOAD= 50 + 112.1= 160 PSF

TOTAL LOADING= 160 PSF* 40 FT = 6400 PLF = 6.4 KLF

FROM SPANCRETE, SELECT INVERTED SPANCRETE T BEAM, 40 x 36

FOR 40' SPAN, MAX LOADING= 8.0 KLF (Tolerance for variation in building programming)

Precast SPANCRETE Floor Panel Loads and Sizes

B. LOADINGS:

3. Dead Loads:

d. Roof:

| | |
|-------------------------|---------------|
| 2" RIGID INSULATION | 2 PSF |
| INVERTED T BEAM | 15 PSF |
| WATER COLLECTION SYSTEM | 3 PSF |
| MECHANICAL MISC. | 4 PSF |
| Total | 21 PSF |

e. Typical Interior:

| | |
|-------------------|-----------------|
| INVERTED T BEAM | 30 PSF |
| SUSPENDED CEILING | 2.5 PSF |
| ELCTRICAL HVAC | 5.5 PSF |
| PLUMBING | 2 PSF |
| INTERIOR COLUMNS | 5.5 PSF |
| MISC. | 1.1 PSF |
| Total | 46.6 PSF |

f. Typical Exterior:

| | |
|-------------------|---------|
| INVERTED T BEAM | 30 PSF |
| SUSPENDED CEILING | 2.5 PSF |
| ELCTRICAL HVAC | 5.5 PSF |
| PLUMBING | 2 PSF |

| | |
|-------------------------|----------|
| EXTERIOR MOMENT COLUMNS | 11 PSF |
| MISC | 1.1 PSF |
| Total | 52.1 PSF |

4. Live Loads:

| | |
|--------------------|---------|
| ROOF | 25 PSF |
| OFFICE | 50 PSF |
| CORRIDORS | 100 PSF |
| LOBBY/ FIRST FLOOR | 100 PSF |

For typical slab on floors 2-5, total superimposed load= $52.1+50 = 102.1$ PSF

From spancrete site, use 12" standard floor slab, 1.5" strand cover, no structural topping, series: 1.5D 12712

Allowable superimposed load=106psf (based on 100% live load at 40' span, therefore allows for programming variations)

Dead Load Weight of Slab= 86 PSF

For first floor, use slab on grade, poured on site.

LOADINGS: Precast SPANCRETE Column Loads and Sizes

C. LOADINGS:

5. Dead Loads:

g. Roof:

| | |
|--------------------------------------|---------------|
| 8" PRESTRESSED HOLLOWCORE FLOOR SLAB | 60 PSF |
| INVERTED T BEAM | 15 PSF |
| WATER COLLECTION SYSTEM | 3 PSF |
| 2" RIGID INSULATION | 2 PSF |
| MECHANICAL MISC. | 4 PSF |
| Total | 84 PSF |

h. Typical Interior:

| | |
|---------------------------------------|------------------|
| 12" PRESTRESSED HOLLOWCORE FLOOR SLAB | 90 PSF |
| INVERTED T BEAM | 30 PSF |
| SUSPENDED CEILING | 2.5 PSF |
| ELCTRICAL HVAC | 5.5 PSF |
| PLUMBING | 2 PSF |
| INTERIOR COLUMNS | 5.5 PSF |
| MISC. | 1.1 PSF |
| Total | 136.6 PSF |

TRIBUTARY AREA = 1600 FT²

TOTAL LOAD = 1600*136.6

= 218560 LB

= 218.6 Kips

i. Typical Exterior:

| | |
|---------------------------------------|-----------|
| 12" PRESTRESSED HOLLOWCORE FLOOR SLAB | 90 PSF |
| INVERTED T BEAM | 30 PSF |
| SUSPENDED CEILING | 2.5 PSF |
| ELCTRICAL HVAC | 5.5 PSF |
| PLUMBING | 2 PSF |
| EXTERIOR MOMENT COLUMNS | 11 PSF |
| MISC | 1.1 PSF |
| Total | 142.1 PSF |

TRIBUTARY AREA = 800 FT²

TOTAL LOAD = 800*142.1

= 113680 LB

= 113.7 Kips

6. Live Loads:

| | |
|--------------------|---------|
| ROOF | 25 PSF |
| OFFICE | 50 PSF |
| CORRIDORS | 100 PSF |
| LOBBY/ FIRST FLOOR | 100 PSF |

7. Lateral Loadings:

| | |
|----------------|---|
| Height (ft) | Min. wind force resisting system Wind pressure (pounds per sq.ft.) |
| 200 FT OR LESS | 20 |

USE 24" x 24" columns for all columns, varying reinforcement.

Cost Estimation of Structural System

This pricing would be for the precast 'erected' in the Chicago area.

Beams - 40 X 36 - \$175 per LF

- From plan, 4900 LF of beams
 - Cost of beams= $\$175 * 4900 = \$857,500$

Columns - 24 X 24 with corbels, multi story - \$175 per LF

- From plan, 3270 LF of columns
 - Cost of columns= $\$175 * 3270 = \$572,250$

12 Inch Spancrete - \$8.00 per SF

- From plan, 244000 SF of floor/roof slab
 - Cost of precast slab= $\$8 * 244000 = \$1,952,000$

Load-bearing insulated wall panels. simple finish, few openings - \$15.00 per SF

- From plan, 53000 SF of load-bearing panels
 - Cost of panels= $\$15 * 53000 = \$795,000$

Non Load-bearing insulated panels-punched openings - \$15.00 per SF

- From plan, 53000 SF of non load-bearing panels
 - Cost of panels= $\$15 * 49600 = \$744,000$

Interior stair and elevator walls - \$13.00 per SF

- From plan, 2500 SF of interior stair and elevator shear walls
 - Cost of interior shear walls= $\$13 * 2500 = \$32,500$

Stairs - Based on the square footage of the stair in plan view - \$50.00 per SF



- From plan, 2750 SF of stairs
 - Cost of Stairs= $\$50 * 2750 = \$137,500$

Total Estimated Cost of Building= \$5,091,000



INVERTED TEE BEAMS

SPANCRETE



40 X 28 Inverted Tee

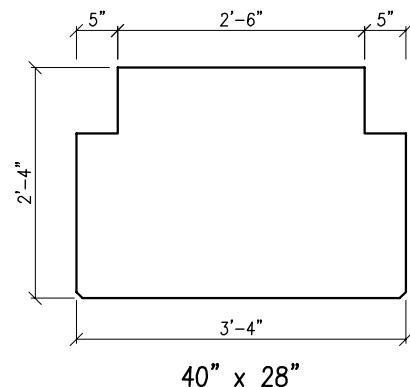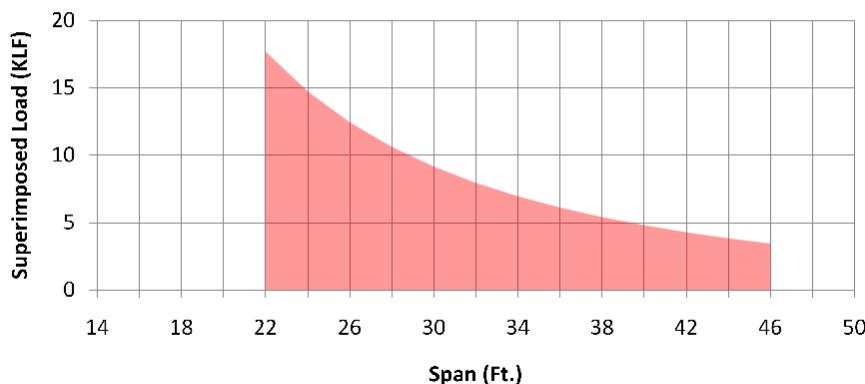

40 X 32 Inverted Tee

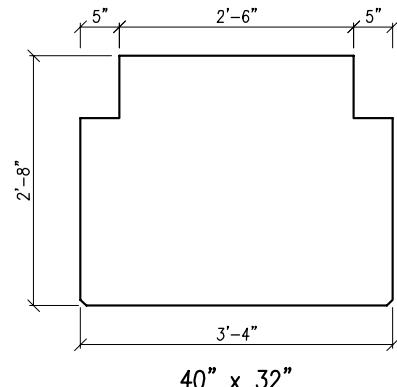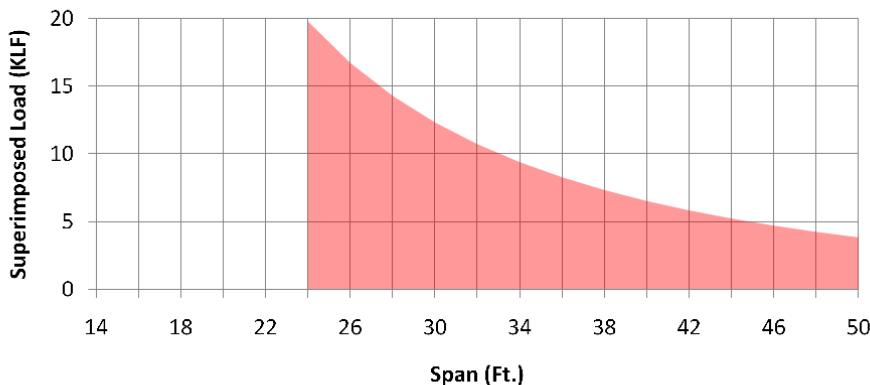

40 X 36 Inverted Tee

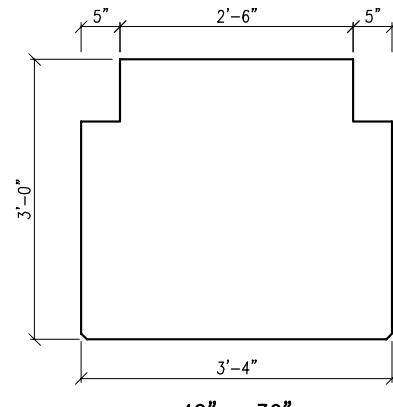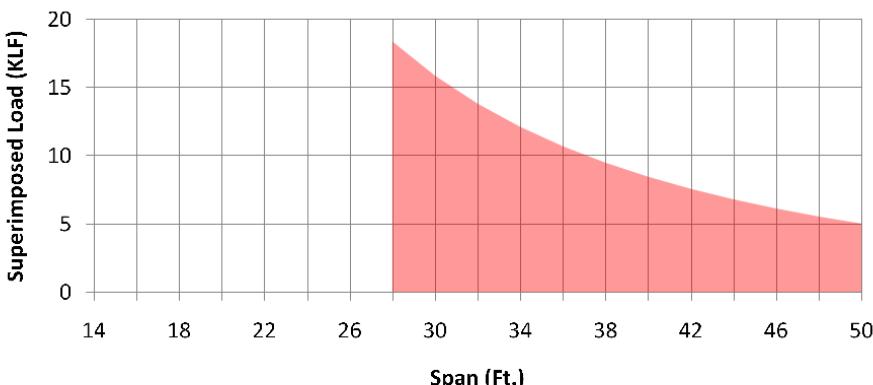


Load Tables are presented as guidelines only. Design requirements must be reviewed by the engineer of record for each specific project.

Spancrete | P.O. Box 828 | Waukesha, WI 53187 | 414-290-9000 | www.spancrete.com

MKLT112-0109

12" STANDARD SPANCRETE
1.50" Strand Cover
No Structural Topping

Dead Load Weight of Slab = 86 psf

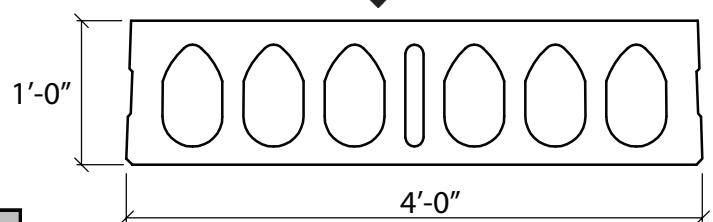

| Section Properties | | | | | | | |
|----------------------------|---|----------------|----------------|----------------|----------------|----------------|----------------|
| | A=355 in ² | Yt=5.72 in | b=15.6 in | | | | |
| | I=5784 in ⁴ | Yb=6.28 in | wt=86 psf | | | | |
| ØM _n ft-k/ft | 22.54 | 30.02 | 39.49 | 48.77 | 57.71 | 63.32 | 74.53 |
| Series | 1.5D- 12606 | 1.5D- 12706 | 1.5D- 12708 | 1.5D- 12710 | 1.5D- 12712 | 1.5D- 12810 | 1.5D- 12812 |
| Span in Feet | Allowable Superimposed Load in Pounds per Square Foot | | | | | | |
| 18 | 283 | 399 | | | | | |
| 19 | 248 | 351 | 483 | | | | |
| 20 | 217 | 311 | 429 | | | | |
| 21 | 191 | 276 | 383 | 469 | | | |
| 22 | 168 | 246 | 344 | 429 | 464 | 483 | |
| 23 | 149 | 219 | 309 | 396 | 426 | 444 | 458 |
| 24 | 131 | 196 | 278 | 359 | 397 | 413 | 435 |
| 25 | 116 | 176 | 251 | 326 | 367 | 382 | 414 |
| 26 | 102 | 158 | 228 | 296 | 344 | 357 | 392 |
| 27 | 90 | 141 | 206 | 270 | 321 | 334 | 366 |
| 28 | 79 | 127 | 187 | 247 | 301 | 313 | 341 |
| 29 | 70 | 114 | 170 | 225 | 277 | 293 | 321 |
| 30 | 61 | 102 | 155 | 206 | 254 | 275 | 299 |
| 31 | | 92 | 141 | 189 | 233 | 253 | 282 |
| 32 | | 82 | 128 | 174 | 214 | 233 | 265 |
| 33 | | 73 | 117 | 159 | 197 | 214 | 250 |
| 34 | | 65 | 106 | 146 | 181 | 198 | 231 |
| 35 | | | 97 | 135 | 167 | 182 | 213 |
| 36 | | | 88 | 124 | 154 | 168 | 197 |
| 37 | | | 80 | 114 | 142 | 156 | 183 |
| 38 | | | 72 | 104 | 130 | 144 | 170 |
| 39 | | | | 96 | 120 | 133 | 158 |
| 40 | | | | 88 | 110 | 123 | 146 |
| 41 | | | | 81 | 102 | 113 | 136 |
| 42 | | | | 74 | 93 | 104 | 126 |
| 43 | | | | | 86 | 96 | 117 |
| 44 | | | | | 78 | 89 | 109 |
| 45 | | | | | 72 | 81 | 101 |
| 46 | | | | | | 75 | 93 |
| 47 | | | | | | 69 | 86 |
| 48 | | | | | | | 80 |
| 49 | | | | | | | 74 |
| 50 | | | | | | | 68 |
| 51 | | | | | | | 63 |

Fire Rating (IBC)

Unrestrained 1 1/2 hours
 Restrained 4 hours

Camber

| |
|------------|
| 1"-1 1/2 " |
| ≥ 1 1/2" |

Wind Turbine Data:

Letter from wind manufacturer representative:

Hey Andrew!

Here is the quota for the 10kw vertical axis wind turbine;

10kw VAWT 1st Generation

Grid Tie 10KW Complete System- **\$42,670** plus shipping

This price includes:

5.5m (18feet) tower
Power-one wind interface box
UGE power-on grid tie inverter
One year warranty

These are the upgrades available for this wind turbine;

Tower

11m (36feet) add \$4230

Accessories

Extended Warranty (per year up to 5 years) add \$757 per year

*This price may seem higher than other wind turbines from other companies at this size but this price includes every component one would need in-order to start producing energy. Often times other companies list their price just for the wind turbine it-self.

*Check with local authorities to see what kind of incentive program are available in the Illinois.

Although you have inquired about our 10kw wind turbine, we often recommend our customers to go with two 4kw wind turbines because of the following reasons;

- The 4kw wind turbine has just being upgraded with the state of the art technology
- Since the 4kw has been upgraded, it is much more efficient than the 10kw

So here is the quota for the 4kw wind turbine

4KW Vertical Axis Wind Turbine 2nd Generation

Complete System Price- **\$21,920** plus shipping before incentives

This price includes;

Urban Green Energy 4kw Wind Turbine
5.5m (18 feet) tower
Power one wind-Interface box (controller)
Power one grid-tie inverter
One year warranty

If you wish, there are some upgrades available;

Tower

11m (36feet) add \$5010
16.5m (54feet) add \$10,130

Accessories

Lightning protection-add \$295
Extended Warranty (per year up to 5 years)- add \$415/year
Power-On Remote Monitoring -add \$1,475

*This price may seem higher than other wind turbines from other companies at this size but this price includes every component one would need in-order to start producing energy.

Often times other companies list their price just for the wind turbine it-self.

*Check with local authorities to see what kind of incentive program are available in the Illinois.

If you have any more questions regarding our product such as the 4kw, let me know and I'll get back to you immediately. Thank you once again!

Takayuki Koizumi

Hey Andrew,

The roof mount costs US\$4000 for the 4kw. And we can not give you the CAD model for our product. Let me know if there is anything else I can do for you.

Taka



UGE-4K 2nd Generation VAWT Grid-Tie



YOU can make a difference

With Urban Green Energy's UGE-4K, you can make your own energy choice and ensure your energy is provided by 100% clean, renewable energy. Quieter than a human whisper, the UGE-4K can be installed on a tower, on a roof, or just about anywhere!

The UGE-4K was designed to power an average American home when the average wind speed is just over 10 mph (16 km/h).



Grid-tie functionality means that when you generate extra electricity it is sold to your utility company; when your wind turbine isn't producing enough electricity the grid will automatically provide required electricity. Using multiple wind turbines will provide even more power. One of our other models may also help you meet your goals.

Please speak to your local distributor or visit our website for more information on our products and government **incentives** that will make your purchase even more affordable!





Power Output

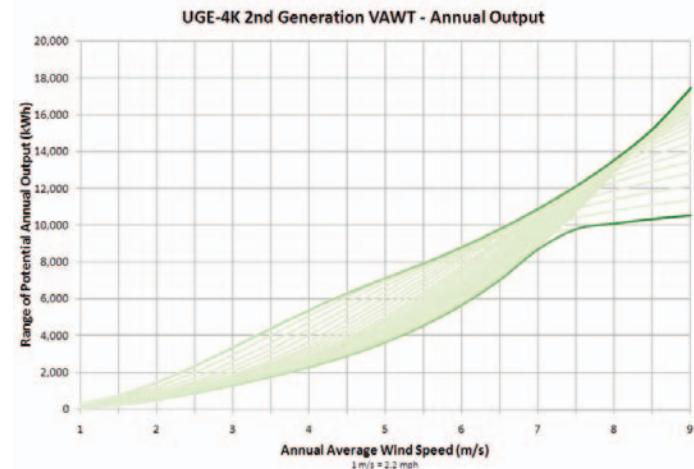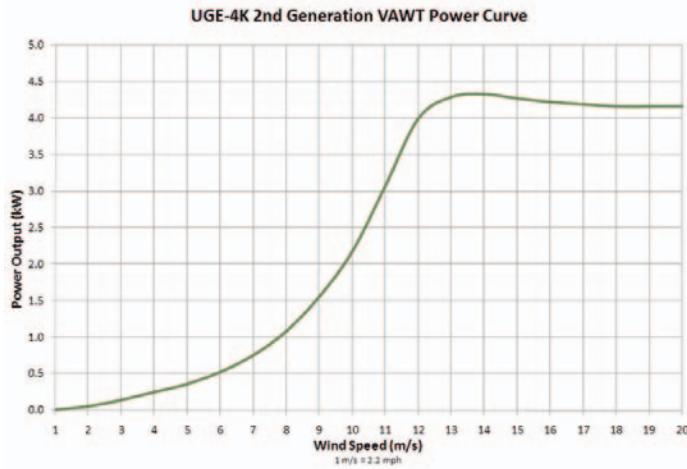

Specifications

Performance:

Rated Power – 4 kW

Rated Wind Speed - 12 m/s

Operating Range - 3 - 25 m/s

Maximum Wind Speed - 50 m/s

Noise Level at 3 Meter Distance:

@ <7 m/s - < 27 DB

@ 7 - 10 m/s - < 32 DB

@ 10 - 13 m/s - < 37 DB

Physical Parameters:

Mill Size - 4.2m x 2.75m (165" x 108")

Tower Height (Standard) - 5.5m (18')

Gross Weight w/o Tower - 200kg (440lbs)

Gross Weight w/ Tower - 500kg (1120lbs)

Gross Weight w. Roof mount - 350kg (770 lbs)

Generator:

Type - Permanent magnet direct drive generator

Temperature range - -40°C to 115°C


Wind Interface Box: (Power-One Aurora PVI-7200)

Output: 0-600Vdc

Grid-tie Inverter: (Power-One Aurora PVI-4200)

Input: 50 - 580Vdc

Grid-tie inverter is ordered to meet local grid specifications. Battery back-up is available as an option.

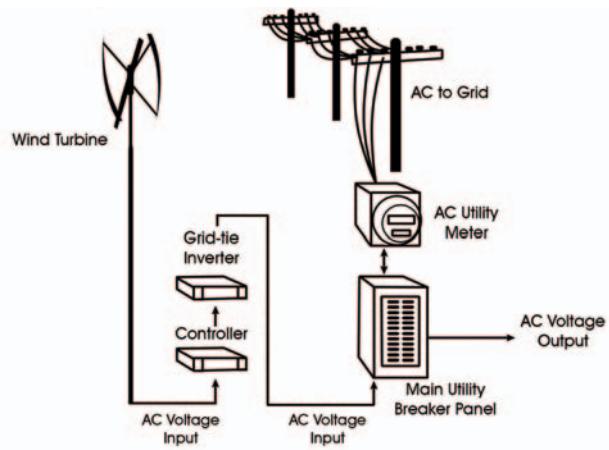

Wind Turbine System Cash Flow

Assumptions (Inputs)

| | |
|---------------------------------|------------------|
| Total Installed Cost (\$): | \$285,120 |
| Allocation to Business (%): | 0 |
| Annual Energy Output (kWh): | 44,000 |
| Electricity Cost (\$/kWh): | \$0.1380 |
| Electricity Inflation Rate (%): | 2 |
| O & M Cost (\$/kWh): | \$0.005 |
| O & M Inflation Rate (%): | 3 |
| State Rebate (%): | 0 |
| State Tax Credit (%): | 25 |
| Federal Tax Credit (%): | 30 |

Results

Ave. Monthly Savings on Bill

| | |
|---------------|--------------|
| Year 1 (\$): | \$506 |
| Year 10 (\$): | \$617 |
| Year 20 (\$): | \$752 |
| Year 30 (\$): | \$917 |

Internal Rate of Return

| | |
|---------------|-------------|
| Years 1 - 30: | 3.0% |
|---------------|-------------|

Annual Cash Flow Model

| Year | Net Energy | O&M Costs | Annual Cash Flow | Total Cash Flow |
|-----------|-----------------|----------------|--------------------|--------------------|
| 0 | | | (\$149,688) | (\$149,688) |
| 1 | \$6,072 | \$0 | \$6,072 | (\$143,616) |
| 2 | \$6,193 | \$0 | \$6,193 | (\$137,423) |
| 3 | \$6,317 | \$0 | \$6,317 | (\$131,105) |
| 4 | \$6,444 | \$0 | \$6,444 | (\$124,662) |
| 5 | \$6,573 | \$0 | \$6,573 | (\$118,089) |
| 6 | \$6,704 | (\$255) | \$6,449 | (\$111,640) |
| 7 | \$6,838 | (\$263) | \$6,575 | (\$105,065) |
| 8 | \$6,975 | (\$271) | \$6,704 | (\$98,361) |
| 9 | \$7,114 | (\$279) | \$6,836 | (\$91,525) |
| 10 | \$7,257 | (\$287) | \$6,970 | (\$84,555) |
| 11 | \$7,402 | (\$296) | \$7,106 | (\$77,449) |
| 12 | \$7,550 | (\$305) | \$7,245 | (\$70,204) |
| 13 | \$7,701 | (\$314) | \$7,387 | (\$62,817) |
| 14 | \$7,855 | (\$323) | \$7,532 | (\$55,285) |
| 15 | \$8,012 | (\$333) | \$7,679 | (\$47,606) |
| 16 | \$8,172 | (\$343) | \$7,829 | (\$39,777) |
| 17 | \$8,336 | (\$353) | \$7,983 | (\$31,794) |
| 18 | \$8,502 | (\$364) | \$8,139 | (\$23,656) |
| 19 | \$8,672 | (\$375) | \$8,298 | (\$15,358) |
| 20 | \$8,846 | (\$386) | \$8,460 | (\$6,898) |
| 21 | \$9,023 | (\$397) | \$8,625 | \$1,727 |
| 22 | \$9,203 | (\$409) | \$8,794 | \$10,521 |
| 23 | \$9,387 | (\$422) | \$8,966 | \$19,487 |
| 24 | \$9,575 | (\$434) | \$9,141 | \$28,628 |
| 25 | \$9,766 | (\$447) | \$9,319 | \$37,947 |
| 26 | \$9,962 | (\$461) | \$9,501 | \$47,448 |
| 27 | \$10,161 | (\$474) | \$9,687 | \$57,135 |
| 28 | \$10,364 | (\$489) | \$9,876 | \$67,010 |
| 29 | \$10,571 | (\$503) | \$10,068 | \$77,078 |
| 30 | \$10,783 | (\$518) | \$10,264 | \$87,343 |

Conservative assumption of no scrap value after 30 years.

Cash flow analysis is pre-tax.

Heat Pump Data:

Ground Loop Design

Zone Report - Equipment - 11/23/2009

Project Name: Green Building Design - Geothermal
 Designer Name: Ali Razeq & Eric Dexter
 Date: 11/20/2009
 Client Name: Illinois Institute of Technology
 Address Line 1: 3300 South State Street
 Address Line 2:
 City: Chicago
 State: IL
 Zip: 60616

Project Start Date: 10/30/2009

Phone: 312-567-3000
 Fax:
 Email: arazeq@iit.edu

Unit Inlet (°F):

COOLING
85.0

HEATING
50.0

Pump Data

| Pump | # | Pump Information | Mode | Capacity (kBtu/hr) | Power (kw) | COP | Flow (gpm) | PLF | Load T (°F) | Load Flow (CFM) |
|--------------|----|-------------------|---------|-----------------------|---------------|------|---------------|------|----------------|--------------------|
| ES070 | 76 | Florida Heat Pump | Cooling | 5221.2 | 364.80 | 14.3 | 1293.3 | 0.99 | 67.0 | 2200 |
| Water to Air | | ES Series R-410A | Heating | 5029.4 | 371.57 | 4.0 | 471.8 | 0.38 | 70.0 | 2200 |

Ground Loop Design

Finance Module Report - 11/23/2009

Project Name: Green Building Design - Geothermal
 Designer Name: Ali Razeq & Eric Dexter
 Date: 11/20/2009
 Client Name: Illinois Institute of Technology
 Address Line 1: 3300 South State Street
 Address Line 2:
 City: Chicago
 State: IL
 Zip: 60616

Project Start Date: 10/30/2009

Phone: 312-567-3000
 Fax:
 Email: arazeq@iit.edu

Geothermal costs (\$)

Annual Costs (\$)

| | Geothermal | Air-cooled chiller / Boiler | Savings |
|------------------------|------------|-----------------------------|------------|
| Total Power: | 44,530.62 | 60,903.82 | 16,373.20 |
| CO2 Emissions: | 7,421.77 | 8,916.63 | 1,494.86 |
| CO2 (tons): | 296.9 | 356.7 | 59.8 |
| Water: | 0.00 | 0.00 | 0.00 |
| Water (Gallons): | 0.0 | 0.0 | 0.0 |
| Maintenance: | 22,500.00 | 168,750.00 | 146,250.00 |
| Mechanical Room Lease: | 0.00 | 750.00 | -312.50 |
| TOTAL: | 75,514.89 | 239,320.45 | 163,805.56 |

NPV Lifecycle Costs (\$) - 15 years

| | Geothermal | Air-cooled chiller / Boiler | Savings |
|------------------------|--------------|-----------------------------|--------------|
| Total Power: | 630,454.70 | 967,354.56 | 336,899.86 |
| CO2 Emissions: | 74,111.17 | 89,038.31 | 14,927.14 |
| CO2 (tons): | 4,453.1 | 5,350.0 | 896.9 |
| Water: | 0.00 | 0.00 | 0.00 |
| Water (Gallons): | 0.0 | 0.0 | 0.0 |
| Maintenance: | 269,677.08 | 2,022,578.07 | 1,752,900.99 |
| Mechanical Room Lease: | 12,734.75 | 8,989.24 | -3,745.51 |
| Installation: | 1,373,500.00 | 1,221,000.00 | (152,500.00) |
| Tax Incentives: | (137,350.00) | 0.00 | 137,350.00 |
| Salvage: | (6,496.59) | (20,789.10) | (14,292.51) |
| TOTAL: | 2,216,631.11 | 4,288,171.07 | 2,071,539.96 |

Ground Loop Design

Borehole Design Project Report - 11/23/2009

| | |
|--|--------------------------------|
| Project Name: Green Building Design - Geothermal | |
| Designer Name: Ali Razeq & Eric Dexter | |
| Date: 11/20/2009 | Project Start Date: 10/30/2009 |
| Client Name: Illinois Institute of Technology | |
| Address Line 1: 3300 South State Street | |
| Address Line 2: | |
| City: Chicago | Phone: 312-567-3000 |
| State: IL | Fax: |
| Zip: 60616 | Email: arazeq@iit.edu |

Calculation Results

| | COOLING | HEATING |
|---------------------------------|---------|---------|
| Total Length (ft): | 83391.2 | 0.0 |
| Borehole Number: | 288 | 288 |
| Borehole Length (ft): | 289.6 | 0.0 |
| Ground Temperature Change ('F): | +6.3 | 0.0 |
| Unit Inlet ('F): | 85.0 | 50.0 |
| Unit Outlet ('F): | 94.9 | 44.0 |
| Total Unit Capacity (kBtu/Hr): | | |
| Peak Load (kBtu/Hr): | 5173.4 | 1887.2 |
| Peak Demand (kw): | 361.5 | 139.4 |
| Heat Pump EER/COP: | 14.3 | 4.0 |
| System EER/COP: | 14.3 | 4.0 |
| System Flow Rate (gpm): | 1293.3 | 471.8 |

Input Parameters

| Fluid | Soil |
|------------------------------|-----------------------------|
| Flow Rate | |
| Fluid: | 51.1 °F |
| Specific Heat (cp): | 1.30 Btu/(h*ft*°F) |
| Density (rho): | 0.75 ft^2/day |
| Piping | |
| Pipe Type: | 1 1/4 in. (32 mm) - SDR11 |
| Flow Type: | Turbulent |
| Pipe Resistance: | 0.104 h*ft*°F/Btu |
| U-Tube Configuration: | Single |
| Radial Pipe Placement: | Along Outer Wall |
| Borehole Diameter: | 5.00 in |
| Grout Thermal Conductivity: | 0.85 Btu/(h*ft*°F) |
| Borehole Thermal Resistance: | 0.185 h*ft*°F/Btu |

Input Parameters

| Pattern | Modeling Time Period |
|---|---|
| Vertical Grid Arrangement: | 18 x 16 |
| Borehole Number: | 288 |
| Borehole Separation: | 20.0 ft |
| Boreholes per Parallel Circuit: | 1 |
| Fixed Length Mode | Off |
| Grid File | None |
| Manufacturer: | Florida Heat Pump |
| Series: | ES Series R-410A |
| Design Heat Pump Inlet Load Temperatures: | Heat Pumps |
| Water to Air: | Cooling (WB) Heating (DB) |
| Water to Water: | 67.0 °F 70.0 °F 55.0 °F 100.0 °F |
| Extra kw | Optional Boiler/Cooling Tower |
| Pump Power | Boiler Tower 0 % |
| Cooling Tower Pump: | Capacity (kBtu/Hr) 0.0 |
| Cooling Tower Fan: | Cooling Tower Flow Rate (gpm) 0.0 |
| Additional Power | Cooling Range ('F): 10.0 Annual Operating Hours (hr/yr): 0 |
| Loads File | |

Ground Loop Design

Zone Report - 11/23/2009

Project Name: Green Buliding Desing - Geothermal
Designer Name: Ali Razeg & Eric Dexter
Date: 11/20/2009
Client Name: Illinois Institute of Technology
Address Line 1: 3300 South State Street
Address Line 2:
 City: Chicago
 State: IL
 Zip: 60616

Project Start Date: 10/30/2009

Phone: 312-567-3000
Fax:
Email: arazeq@iit.edu

| Time of Day | Design Day Loads | | Annual Cooling: 1100 | Equivalent Full-Load Hours |
|-----------------|-------------------------|--------------------------|-----------------------------|----------------------------|
| | Heat Gains (kBtu/Hr) | Heat Losses (kBtu/Hr) | | |
| 8 a.m. - Noon | 541.8 | 1887.2 | | |
| Noon - 4 p.m. | 5173.4 | 310.7 | | |
| | | | Days Occupied per Week: 5.0 | |
| 4 p.m. - 8 p.m. | 541.8 | 310.7 | | |
| 8 p.m. - 8 a.m. | 541.8 | 310.7 | | |

Heat Pumps

Pump Name: ES070
Number of Units: 76
Manufacturer: Florida Heat Pump
Series: ES Series R-410A
Pump Type: Water to Air

| | Cooling | Heating |
|---------------------|-------------|-----------|
| Capacity (kBtu/Hr) | 5221.2 | 5029.4 |
| Power (kw) | 364.80 | 371.57 |
| EER/COP | 14.3 | 4.0 |
| Flow Rate (gpm) | 1293.3 | 471.8 |
| Partial Load Factor | 0.99 | 0.38 |
| Load Temp. (°F) | 67.0 | 70.0 |
| Load Flows | (CFM) (gpm) | 2200 2200 |

ENVIROSAVER

heat pumps

ES SERIES

Our single state **ES EnviroSaver Series** is designed to provide your customer a highly efficient unit at a cost effective price. Our greatest challenge today is the preservation of our environment. Depletion of the ozone and global warming are both addressed by FHP's **EnviroSaver Series**. Refrigerant R-410A, the industry's alternative to ozone depleting refrigerant R-22 meets EPA standards. High efficiency not only saves your customer money on their energy bills but helps reduce carbon dioxide emissions, a leading cause of global warming.

FHP's **EnviroSaver Series** is designed with ECM (Electronically Commuted Motor) fan motors as standard. This motor will provide additional energy savings and a greater level of comfort in the living space. When dirt builds up on the filter reducing air flow the ECM motor automatically adjusts to maintain full air flow ensuring peak performance of the unit and no loss of comfort. All FHP's **ES EnviroSaver** units are ARI/ISO 13256-1 performance certified for Water Loop, Ground Loop and Ground Water applications making them suitable for virtually any application. ES units are available in Vertical, Horizontal and Counter Flow models as well as multiple return and supply air configurations making it easy to find a unit to meet your requirements.



All FHP Series units come ready for operation in a geothermal application. Geothermal installations are the most cost-effective and energy efficient heating and cooling systems available today.

Increase your energy savings with an internally mounted heat recovery system providing much of your hot water needs at virtually no additional operating cost.

● Cost Effective

Up to 60% savings are possible using FHP's **ES EnviroSaver Series** in a geothermal application. Additional investment costs are more than offset when energy cost savings are considered. The system's long life and low maintenance help reduce the overall life cycle costs.

● Environmentally Friendly

FHP is the industry leader in the development of the environmentally friendly technology that is designed into the **EnviroSaver Series**. Using Refrigerant R-410A gives you protection from potentially skyrocketing maintenance costs associated with obsolete refrigerants.

● FHP Quality and Reliability

FHP's **EnviroSaver Series** feature coated evaporator coils and stainless steel drain pans as standard to ensure long trouble free life of the units. Rigorous factory testing of each unit ensures trouble free operation from the start while FHP's thirty years of experience in heat pumps are your assurance of a state of the art quality product.


ISO 9001:2000 Certified




ES SERIES

PERFORMANCE DATA


VERTICAL

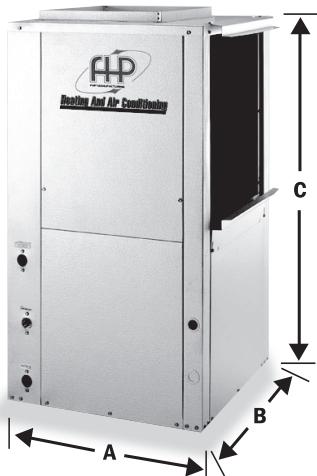

HORIZONTAL

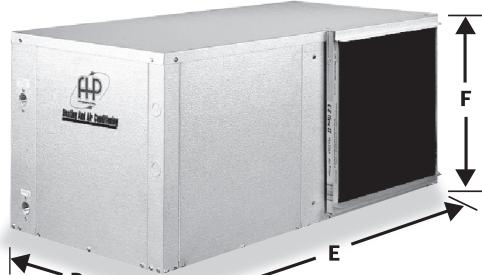

COUNTERFLOW

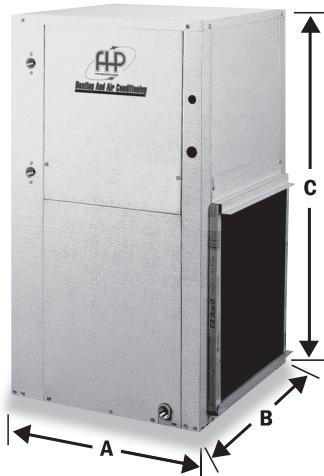

| DIMENSIONS | | | | | | |
|------------|------------------|-------|--------|------------|--------|--------|
| MODEL | VERTICAL/C. FLOW | | | HORIZONTAL | | |
| | WIDTH | DEPTH | HEIGHT | WIDTH | LENGTH | HEIGHT |
| ES018 | 21.50 | 21.50 | 40.25 | 25.50 | 43.00 | 21.75 |
| ES024 | 21.50 | 21.50 | 40.25 | 25.50 | 43.00 | 21.75 |
| ES030 | 21.50 | 26.00 | 47.25 | 26.00 | 54.50 | 21.75 |
| ES036 | 21.50 | 26.00 | 47.25 | 26.00 | 54.50 | 21.75 |
| ES042 | 24.00 | 32.75 | 47.25 | 30.00 | 68.00 | 21.75 |
| ES048 | 24.00 | 32.75 | 47.25 | 30.00 | 68.00 | 21.75 |
| ES060 | 26.00 | 33.25 | 51.25 | 30.00 | 68.00 | 21.75 |
| ES070 | 26.00 | 33.25 | 58.25 | 30.00 | 78.00 | 21.75 |

All ratings & specifications are subject to change without notice.

| MODEL | CFM | ARI / ISO 13256-1 PERFORMANCE DATA | | | | | | | | | | | |
|------------------------------|------|------------------------------------|------------|-------------------------|------------|-------------------------|--------------|-------------------------|------------|-------------------------|------------|-------------------------|------------|
| | | ENTERING WATER TEMPERATURES | | | | | | | | | | | |
| | | Water Loop | | Ground Loop | | | Ground Water | | | | | | |
| | | 86°F | 68°F | 77°F | 32°F | 59°F | 50°F | | | | | | |
| CAPACITY AND EFFICIENCY DATA | | | | | | | | | | | | | |
| | | COOLING CAPACITY (WLHP) | EER (WLHP) | HEATING CAPACITY (WLHP) | COP (WLHP) | COOLING CAPACITY (GLHP) | EER (GLHP) | HEATING CAPACITY (GLHP) | COP (GLHP) | COOLING CAPACITY (GWHP) | EER (GWHP) | HEATING CAPACITY (GWHP) | COP (GWHP) |
| ES018 | 650 | 18,500 | 15.2 | 24,000 | 5.6 | 19,500 | 19.6 | 14,500 | 3.5 | 22,000 | 27.4 | 19,000 | 4.4 |
| ES024 | 800 | 25,000 | 14.2 | 32,500 | 4.3 | 27,000 | 15.9 | 20,500 | 3.4 | 29,500 | 21.9 | 26,500 | 3.7 |
| ES030 | 1000 | 30,000 | 16.0 | 33,500 | 4.8 | 31,000 | 19.0 | 22,000 | 3.5 | 34,500 | 25.0 | 27,500 | 4.2 |
| ES036 | 1200 | 33,000 | 15.6 | 39,000 | 5.2 | 34,000 | 19.0 | 24,000 | 3.5 | 38,500 | 23.9 | 31,500 | 4.4 |
| ES042 | 1400 | 43,000 | 14.3 | 47,000 | 4.7 | 44,500 | 16.5 | 30,500 | 3.3 | 47,000 | 21.6 | 39,000 | 4.1 |
| ES048 | 1600 | 48,500 | 14.3 | 58,000 | 4.9 | 49,000 | 17.2 | 37,500 | 3.5 | 55,000 | 21.6 | 47,000 | 4.3 |
| ES060 | 2000 | 57,500 | 13.6 | 66,000 | 4.4 | 60,000 | 15.6 | 45,000 | 3.3 | 68,000 | 20.1 | 56,000 | 3.9 |
| ES070 | 2200 | 68,000 | 14.0 | 80,000 | 4.6 | 70,000 | 15.6 | 53,000 | 3.3 | 76,000 | 20.3 | 68,000 | 4.1 |

Tabulated performance data is at noted entering water temperatures and entering air conditions of 80.6°F DB/66.2°F WB at ARI/ISO 13256-1 rated CFM

ENERGY STAR RATED



FHP MANUFACTURING COMPANY

601 N.W. 65TH COURT • FT. LAUDERDALE, FL 33309 • PHONE: (954) 776-5471 • FAX: (800) 776-5529

CANYON VIEW HIGH SCHOOL

CEDAR CITY, UTAH

Andrew Chiasson
Geo-Heat Center



LOCATION & BACKGROUND

The Canyon View High School is located in Cedar City, UT, about 90 miles (145 km) northeast of the point of intersection of Utah, Arizona, and Nevada. It is a two-story building with 233,199 ft² (21,665 m²) of floor space, and construction was completed in 2001.

Average high temperatures in the region in July are about 93°F (33.9°C) and average low temperatures in January are about 15°F (-9.4°C). There are approximately 6100 (3390°C-day) heating degree days and 700 (390°C-day) cooling degree days per year [65 °F (18°C) base].

The Canyon View ground-source heat pump system is considered the first “large” geoexchange system in the Central Rocky Mountain Region.

SYSTEM DESCRIPTION

Ground Source System

The ground source system (Figure 1) is the vertical closed loop type consisting of 300 vertical boreholes, each 300 ft (91.4 m) deep, for a total length of 90,000 ft (27,432 m). The boreholes, installed under the school playing field, are placed in a 15 x 20 grid pattern with a 20-ft (6.1-m) borehole spacing and 25-ft (7.6-m) spacing between run-outs. A single u-tube heat exchanger is installed in each borehole, and the borehole field is piped in a reverse-return arrangement.

The mean annual ground temperature in this location is approximately 53°F (11.7°C). An in-situ thermal

conductivity test revealed that the average thermal conductivity of the soil to a depth of 300 ft (91.4 m) is 1.19 Btu/hr-ft⁻²F (2.06 W/m⁻²C). The loop field was installed in basin-fill type sediments, consisting of coarse sand and gravel with clay stringers and trace volcanics.

Interior System

The total installed heat pump capacity at the Canyon View High School is approximately 550 tons (1953 kW). Space conditioning is accomplished by over 100 water-air heat pumps, which are installed in ceiling spaces to serve individual classrooms and other zones. Outdoor air is introduced through heat recovery ventilator (HRV) units. The original design called for total energy recovery (ERV) units, but HRV's were installed due to lower cost. There is little use of domestic hot water in the school, and thus it is generated partially by water-water heat pumps and natural-gas water heaters. The fluid distribution system consists of a central pumping system with a variable frequency drive.

A generalized schematic of the system is shown in Figure 2. Figure 3 is a photograph of the ground-loop headers in the mechanical room and Figure 4 is a photograph of a typical horizontal, ceiling-mounted water-air heat pump.

PROJECT COSTS

The Canyon View High School is an example of a building where a ground-source heat pump system was

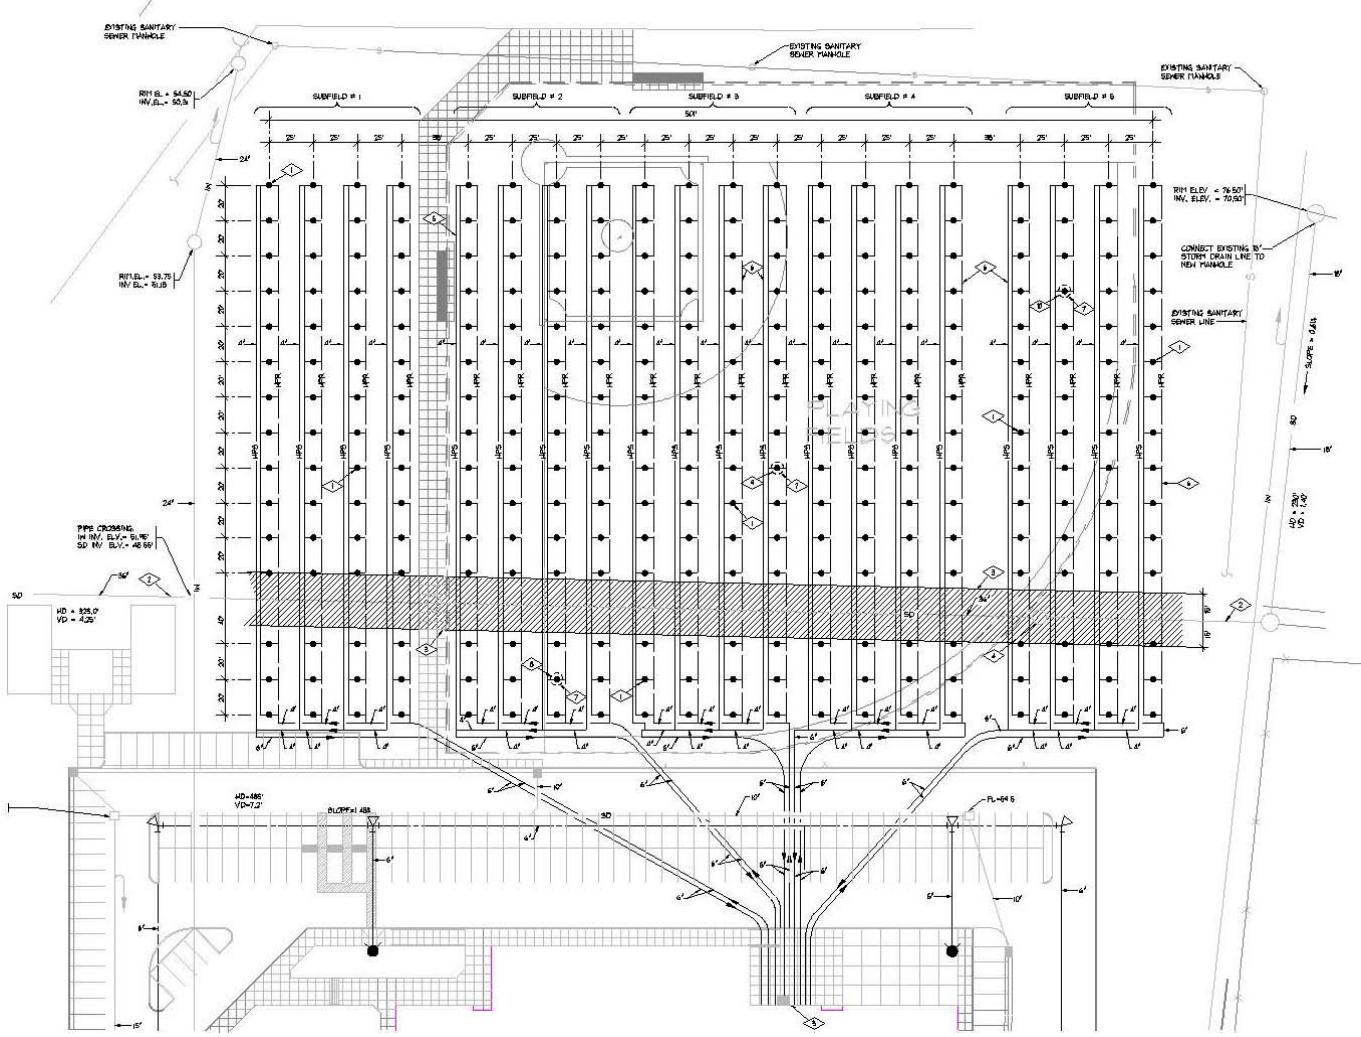


Figure 1. Canyon View High School ground loop field.

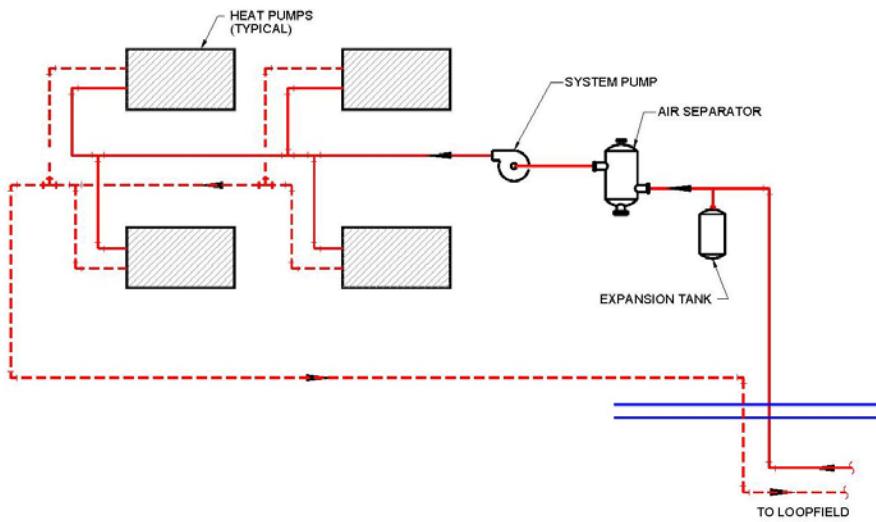


Figure 2. Schematic of the ground-source heat pump system at the Canyon View High School.

cheaper to install than a conventional boiler chiller system. The project costs are summarized as follows:

- Conventional Mechanical System Bid:
\$17.00/ft² (\$183.00/m²)
- Canyon View High School Ground Source System Bid:

| | |
|---|--|
| Mechanical/Plumbing bid: | \$2,457,000 |
| Loop Field bid: | <u>\$778,000</u> |
| Total Ground Source bid: | \$3,235,000 |
| Mechanical Cost/ft ² (m ²): | \$13.87/ft² (\$149.30/m²) |
| Cost Savings: \$3.13/ ft ² (\$33.69/m ²) = | <u>\$729,000</u> |

Additional cost savings may be realized if one considers architectural savings in the mechanical room floor space in the ground-source system over the conventional system. For the Canyon View High School, the mechanical room for the ground-source system is 2,680 ft² (249 m²), or 1.15% of the total floor space. Comparing this value to 3.80% of mechanical room floor space to total floor space for average schools, and assuming \$50/ft² (\$538/m²) cost of new construction, an additional savings of \$309,000 may be realized.



Figure 3. Photograph of the mechanical room at the Canyon View High School, showing the ground loop field supply and return headers.

SYSTEM PERFORMANCE AND OPERATING COST

The system has performed as designed. Maximum ground loop temperatures observed in the summer are about 92°F (33.3°C) and minimum loop temperatures in the winter are 40-42°F (4.4–5.5°C). Annual utility costs for 2001-2002 are summarized as follows:

- Annual Utility Costs for Canyon View High School:

| | | |
|---|---|-------|
| Electricity: | \$135,886.54 | (96%) |
| Natural Gas: | <u>\$5,446.87</u> | (4%) |
| Total: | \$141,333.41 | |
| Cost/ft ² (m ²): | \$0.61/ft ² (\$6.57/m ²) | |

- Utility Costs for a Comparable School:
Cost/ft² (m²): \$0.86/ft² (\$9.26/m²)
(77% electrical, 23% gas)
- Operating Cost Savings: \$0.25/ ft² (\$2.69/m²)
= **\$58,300 (or 29%)/year**



Figure 4. Photograph of a typical horizontal, ceiling-mounted water-air heat pump.

OPERATING EXPERIENCES

Although the geoexchange system at the Canyon View High School is performing well, it is a large system, and the designer admits that there are ways that the pumping system could have been designed to optimize energy consumption. For example, systems of similar size are being designed with primary/secondary pumping, multiple loop pumps to utilize only as much of the ground loop as necessary, and distributed pumping in the building.

Most heat pumps are installed in ceiling spaces, and access has been a bit tight. Dirt and sand was a problem in the system for about 6 months after start-up, which was attributed to a damaged header pipe, likely caused by landscaping work.

ACKNOWLEDGEMENTS

The Geo-Heat Center wishes to thank Cary Smith of Sound Geothermal for providing the data and information for this case study

OVERALL SUMMARY

Building Description:

Location: Cedar City, Utah

Occupancy: School

Gross Floor Area: 233,199 ft² (21,665 m²)

Number of Floors: 2

Type of Construction: New

Completion Date: 2001

July Avg. High Temp.: 93°F (33.9°C)

Jan Avg. Low Temp.: 15°F (-9.9°C)

Annual Heating Degree Days: 6100°F-day (3390°C-day)

Annual Cooling Degree Days: 700°F-day (390°C-day)

Interior System:

Total Installed Heat Pump Capacity: ~550 tons (1,935 kW)

No. of Heat Pump Units: 100+

Pumping System: Central with VFD

Ground-Source System:

Geologic Materials: Basin-fill sediments

Mean Ann. Ground Temp.: 53°F (11.7°C)

Type: Vertical closed loop, single U-tube

Configuration: 300 boreholes (15x20 grid pattern)

300 ft (91.4 m) deep,

20 to 25 ft (6.1 to 7.6 m) spacing

Borehole per ton: ~164 ft/ton (14.2 m/kW)

Economic Analysis:

Installed Geothermal HVAC Capital Cost:

\$3,235,000 (\$13.87/ft²)(\$149.30/m²)

Conventional HVAC Capital Cost Bid:

\$3,963,363 (\$17.00/ft²)(\$183.00/m²)

Annual HVAC Energy Cost (2001-2002):

\$141,333 (\$0.61/ft²)(\$6.57/m²)

Annual HVAC Energy Cost of Comparable Conventional School:

\$200,500 (\$0.86/ft²) (\$9.26/m²)

Annual HVAC Energy Savings:

29%

Estimated Simple Payback Period:

Immediate

Photovoltaic Data:

20,265 SF of Solar panel area on the south facade

230 Wp per panel of power

Each panel is 18 SF

$20,265 / 18 = 1125$ panels

4.5 kWh/m²/day from PV solar radiation graph

Insolation Percent: 18.75%

kWh/panel = $(230W \times .1875 \times 87600h) / 1000 = 377.8$ kWh/panel

1125 panels x 377.8 kWh/panel = 424,996.8 kWh produced per year

\$793 per panel

\$892,125 total

| Converting kWh/m ² /day to kWh: | | kWh/m ² /day * 1day/24h = kWh/m ² | | | | | |
|--|------------------|---|--------------|----------------------------------|---|--|--|
| kWh/m ² /day | W/m ² | Rated Insolation | Insolation % | Power Produced (kWh/panel) | Total Power Produced Annually (kWh) | | |
| 4.5 | 187.5 | 1000 | 18.75% | 377.775 | 424996.875 | | |
| 5 | 208.333 | 1000 | 20.83% | 419.75 | 472218.75 | | |


Insolation
Percentage is based
on 1000W/m² PV
Standard Test
Conditions.

Spreadsheet Calcs

PV Solar Radiation (Flat Plate, Facing South, Latitude Tilt)

Annual

Model estimates of monthly average daily total radiation using inputs derived from satellite and/or surface observations of cloud cover, aerosol optical depth, precipitable water vapor, albedo, atmospheric pressure and ozone resampled to a 40km resolution. See http://www.nrel.gov/gisll_solar_pv.html documentation for more details.

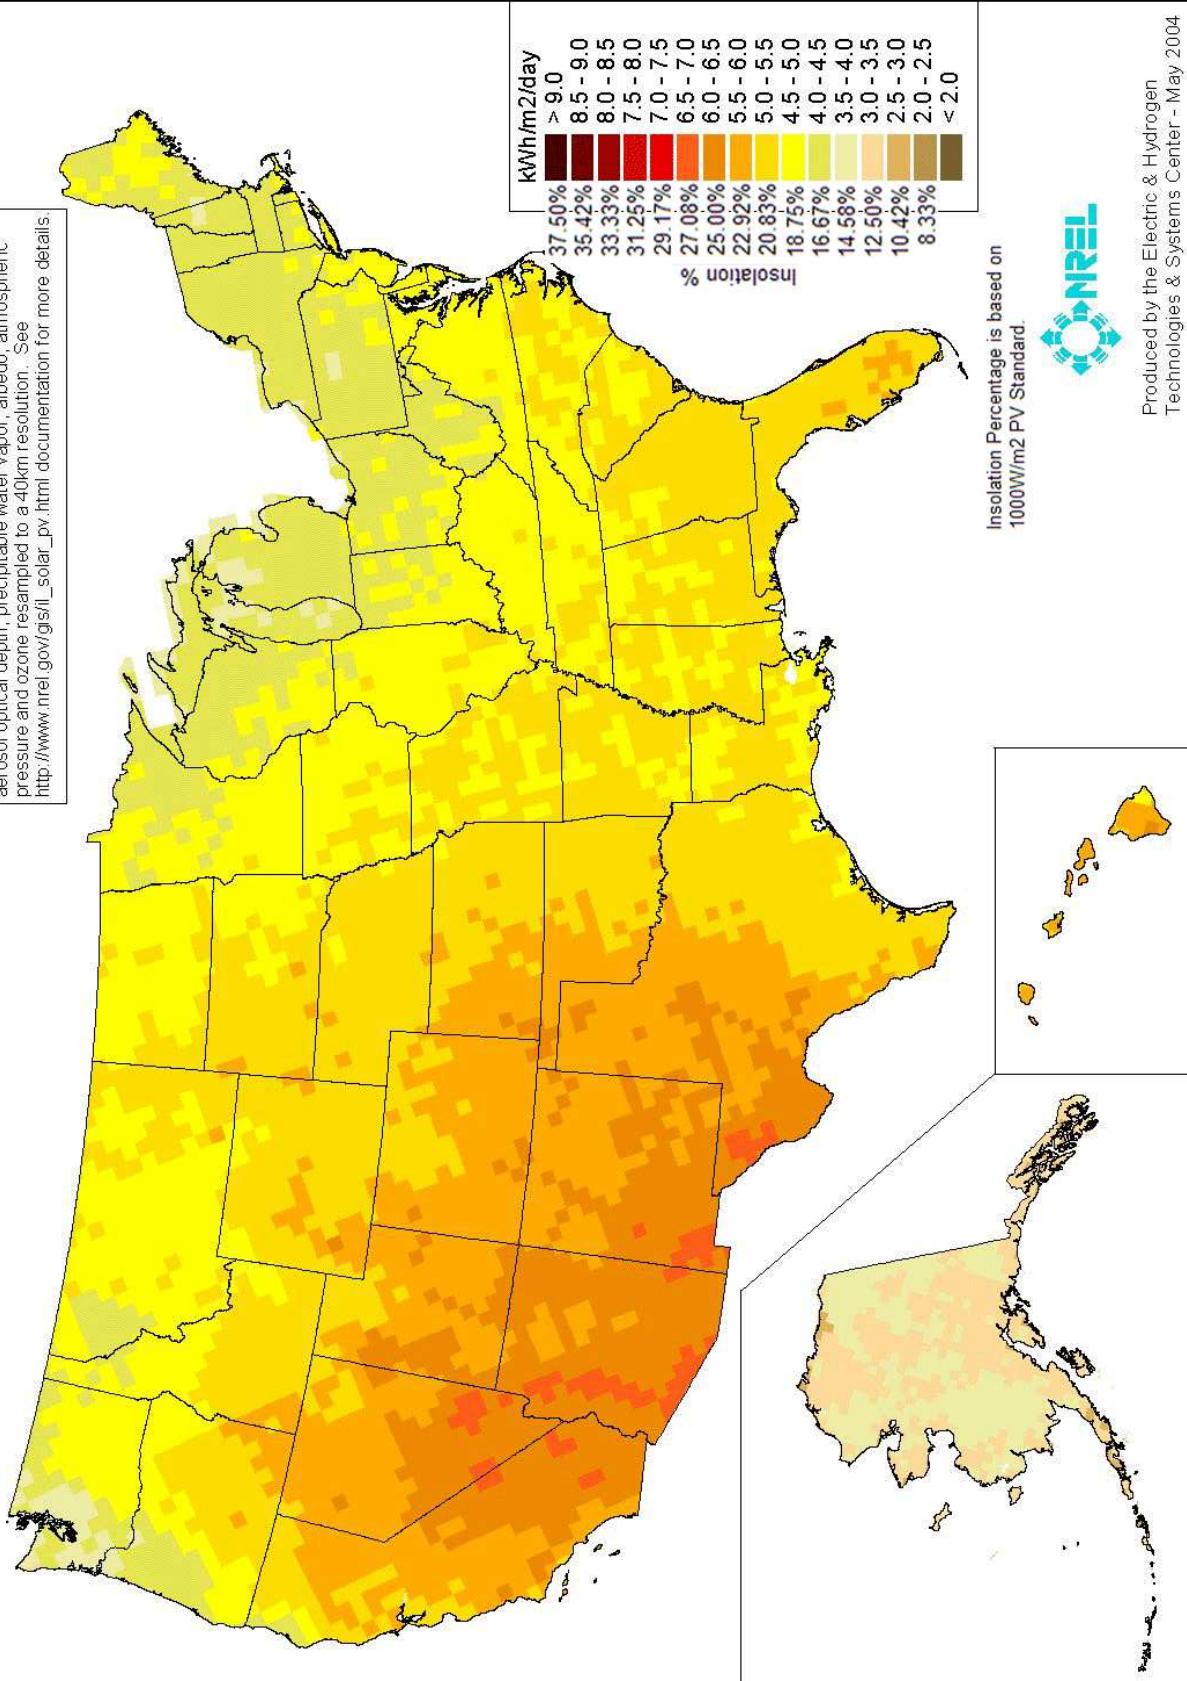



Sunmodule[®] SW 220/230 mono



The Sunmodule from SolarWorld represents one of the best values in the PV industry. The Sunmodule's tight power tolerance of +/-3% ensures the highest system efficiency without the need for on-site module sorting. The fully automated manufacturing process at SolarWorld's ISO 9001-2000 factories produces modules with consistently high quality. Choosing the Sunmodule[®] will ensure high kWh yields for the long term.

To guarantee long term yields, Sunmodules are built to last. SolarWorld bonds the tempered glass laminate deep into the aluminum frame with a continuous bead of silicone adhesive. This method guarantees exceptional rigidity for the entire module and prevents the frame from loosening or pulling away from the glass in cases such as the sliding of heavy snow or handling. Tests carried out in accordance with IEC 61215, which applies loads of up to 113 lb/sf (5.4 kN/m²) demonstrate that the module can withstand high loads such as heavy accumulations of snow and ice.

The Sunmodule[®] features a patented, low profile junction box with integrated 25A Schottkey bypass diodes that is completely sealed against corrosion. The ability to rapidly dissipate excess heat allows the diodes and junction box to operate at lower temperatures. The junction box is reliably connected by a solid, welded bond to guarantee lasting functionality and is factory-equipped with high-quality, robust cables and locking connectors. All Sunmodules carry a 25-year performance warranty and can be returned to SolarWorld at their end of life for recycling.



Sunmodule®

SW 220/230 mono

Performance under standard test conditions

| | | |
|-----------------------------|-----------|------------------|
| Maximum power | P_{max} | SW 220 220 Wp |
| Open circuit voltage | V_{oc} | 36.6 V |
| Maximum power point voltage | V_{mpp} | 29.3 V |
| Short circuit current | I_{sc} | 8.18 A |
| Maximum power point current | I_{mpp} | 7.51 A |

| |
|------------------|
| SW 230 230 Wp |
| 36.9 V |
| 29.6 V |
| 8.42 A |
| 7.76 A |

Performance at 800 W/m², NOCT, AM 1.5

| | SW 220 | SW 230 |
|-----------------------------|-----------|--------|
| Maximum power | 157 Wp | 164 Wp |
| Open circuit voltage | V_{oc} | 33.1 V |
| Maximum power point voltage | V_{mpp} | 26.3 V |
| Short circuit current | I_{sc} | 6.76 A |
| Maximum power point current | I_{mpp} | 5.98 A |
| | | 6.18 A |

Minor reduction in efficiency under partial load conditions at 25°C: at 220 W/m², 95% (+/- 3%) of the STC efficiency (1000 W/m²) is achieved.

Component materials

| | |
|------------------|--|
| Cells per module | 60 |
| Cell type | monocrystalline silicon |
| Cell dimensions | 6.14 x 6.14 in ² (156 x 156 mm ²) |

System integration parameters

| | |
|--------------------------------|---|
| Maximum system voltage SC II | 1,000 V _{DC} |
| Maximum system voltage USA NEC | 600 V _{DC} |
| Maximum series fuse rating | 15 A |
| Maximum reverse current | Do not apply external voltages larger than V_{oc} to the module |


Thermal characteristics

| | |
|--------------|-----------|
| NOCT | 46°C |
| TC I_{sc} | 0.042 %/K |
| TC V_{oc} | -0.33 %/K |
| TC P_{max} | -0.45 %/K |


Additional data

| | |
|-----------------|-----------|
| Power tolerance | +/- 3 % |
| Junction box | IP 65 |
| Connector | MC type 4 |

Front

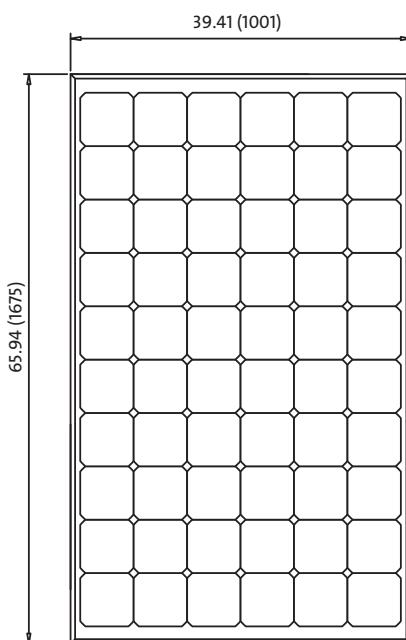


Side

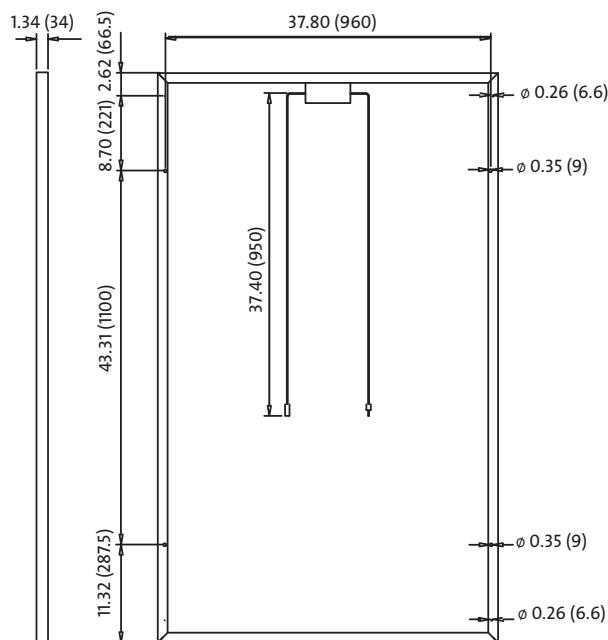

Rear

Construction



- [1] Front: tempered glass
- [2] crystalline solar cells embedded in EVA (ethylene-vinyl-acetate)
- [3] Rear: Backsheet

*inches (mm)

Rainwater Collection Data:

Calculations

- Total building area: 221000 sf
 - Roof area: 37000 sf
 - Rain water harvesting area: 18700 sf
 - Chicago average precipitation: 38.01 in/year
: (3.2 in/month)
 - Rainwater calculator $A = (\text{catchment area of building})$
 $R = (\text{inches of rain})$
 $G = (\text{total amount of collected rainwater})$
 $(A) \times (R) \times (600 \text{ gallons}) / 1000 = (G)$
 - Total amount of collected rainwater: 35900 gal/month
- Saving 430800 gallons of rainwater every year
- Total occupation of the building: 2750 people
 - Average person uses 4.2 gal for flushing a day
 - Total use of flushing water: 10150/day
Saving 11.82% of flushing water
 - Tank Construction Table and Cost

| | Light duty ferrocement | | Medium duty ferrocement | | Heavy duty ferrocement | |
|---|------------------------|------------|-------------------------|------------|------------------------|------------|
| Tank volume | 3000.00 | gallons | 3000.00 | gallons | 3000.00 | gallons |
| Height | 8.00 | feet | 8.00 | feet | 8.00 | feet |
| Wall thickness (av) | 1.00 | inches | 1.25 | inches | 2.00 | inches |
| Roof thickness | 1.00 | inches | 1.00 | inches | 1.75 | inches |
| Floor thickness | 3.00 | inches | 4.00 | inches | 5.00 | inches |
| Roof rise/tank diameter | 0.10 | ratio | 0.10 | ratio | 0.10 | ratio |
| Floor beyond walls | 1.00 | inches | 3.00 | inches | 5.00 | inches |
| Density of material | 100.00 | lbs/ft3 | 100.00 | lbs/ft3 | 100.00 | lbs/ft3 |
| Hoop spacing | 6.00 | inches | 18.00 | inches | 24.00 | inches |
| Major reinforcing diameter | 0.13 | inches | 0.38 | inches | 0.38 | inches |
| Note that volume under roof below is in ADDITION TO capacity above. | | | | | | |
| Diameter | 7.99 | feet | 7.99 | feet | 7.99 | feet |
| Diameter/ height | 1.00 | ratio | 1.00 | ratio | 1.00 | ratio |
| Volume | 401.02 | feet | 401.02 | feet | 401.02 | Cubic feet |
| Volume under roof | 20.29 | Cubic feet | 20.29 | Cubic feet | 20.29 | Cubic feet |
| Volume under roof | 151.80 | Gallons | 151.80 | Gallons | 151.80 | Gallons |
| Total volume | 421.31 | Cubic feet | 421.31 | Cubic feet | 421.31 | Cubic feet |

| | | | | | | |
|-------------------------------|---------------|--------------|---------------|--------------|---------------|--------------------|
| Radius | 3.99 | Feet | 3.99 | Feet | 3.99 | Feet |
| Roof rise | 0.80 | | 0.80 | Feet | 0.80 | |
| Circumference | 25.10 | Feet | 25.10 | Feet | 25.10 | Feet |
| Roof area | 50.13 | Square feet | 50.13 | Square feet | 50.13 | Square feet |
| Wall area | 200.77 | Square feet | 200.77 | Square feet | 200.77 | Square feet |
| Total stucco area | 250.89 | Square feet | 250.89 | Square feet | 250.89 | Square feet |
| Floor area | 52.24 | Square feet | 56.60 | Square feet | 61.13 | Square feet |
| Total area | 303.13 | | 307.49 | feet | 312.02 | |
| (cylinder) | 301.02 | Cubic feet | 301.02 | feet | 301.02 | |
| Roof volume | 4.18 | feet | 4.18 | feet | 7.31 | Cubic feet |
| Wall volume | 16.73 | Cubic feet | 20.91 | feet | 33.46 | Cubic feet |
| Total stucco volume | 20.91 | feet | 25.09 | feet | 40.77 | Cubic feet |
| Total stucco volume | 0.77 | Cubic yards | 0.93 | yards | 1.51 | Cubic yards |
| Floor volume | 13.06 | feet | 18.87 | feet | 25.47 | Cubic feet |
| Floor volume | 0.48 | Cubic yards | 0.70 | yards | 0.94 | Cubic yards |
| Total volume | 33.97 | Cubic feet | 43.96 | feet | 66.24 | Cubic feet |
| Total volume | 1.26 | yards | 1.63 | yards | 2.45 | Cubic yards |
| Material vol/water vol | 12.40 | ratio | 9.58 | ratio | 6.36 | ratio |
| Weight of material | 3,396.78 | lbs | 4,395.61 | lbs | 6,624.15 | lbs |
| Weight of water | 26,286.05 | lbs | 26,286.05 | lbs | 26,286.05 | lbs |
| Total weight | 29,682.83 | lbs | 30,681.66 | lbs | 32,910.20 | lbs |

- 11 tanks needed (each tank's volume : 3000gal)


- Construction Cost

| Material | Unit cost | 3000 gal | | 9,000 gal | | 12,000 gal | |
|--|-----------|----------|--------------|-----------|--------------|------------|--------------|
| | | 30 | \$93.30 | 50 | ##### | 60 | ##### |
| 3/8" rebar (20' pieces) | \$3.11 | 30 | \$93.30 | 50 | ##### | 60 | ##### |
| 1/2" rebar (20' pieces) | \$4.98 | 2 | \$0.00 | | \$0.00 | | \$0.00 |
| Lath (27"x8' pieces) | \$5.36 | 27 | ##### | 40 | ##### | 50 | ##### |
| 6x6x10x10 Welded Wire Mesh (7'x200' rolls) | ##### | 1 | ##### | 1.25 | ##### | 1.5 | ##### |
| 1/2" Hardware cloth (4'x100' rolls) | \$39.94 | 1 | \$39.94 | 1.75 | \$69.90 | 2 | \$79.88 |
| Tie wire (big looped bundles) | \$2.60 | 2 | \$5.20 | 2 | \$5.20 | 3 | \$7.80 |
| Cement (94 lb bags) | \$5.65 | 18 | ##### | 25 | ##### | 32 | ##### |
| Plaster sand (yd3) | \$29.50 | 4 | ##### | 4.5 | ##### | 5.5 | ##### |
| Water (gal) | \$0.01 | 500 | \$5.00 | 750 | \$7.50 | 1000 | \$10.00 |
| Thoroseal/Bonsal Sure Coat (50 lb bags) | \$19.20 | 7 | ##### | 10 | ##### | 15 | ##### |
| Color (lbs) | \$2.88 | 5 | \$14.40 | 7 | \$20.16 | 10 | \$28.80 |
| Hog rings (25 lb boxes)37 | \$38.40 | | \$0.00 | | \$0.00 | 1 | \$38.40 |
| Hog ring staples (boxes of 10,000) | \$10.00 | 1 | \$10.00 | 2 | \$20.00 | 2 | \$20.00 |
| Dobies | \$0.50 | 30 | \$15.00 | 50 | \$25.00 | 65 | \$32.50 |
| Poles | \$16.50 | 6 | \$99.00 | 10 | ##### | 15 | ##### |
| Concrete (yd3) | \$91.50 | 2 | ##### | 3.5 | ##### | 4.5 | ##### |
| Approx. cost (\$) | | | 1,102 | | 1,641 | | 2,169 |

- One unit approximate cost is \$1,102
- Total Construction cost is \$12,122

Reference

- Rainwater Harvest Guide
<http://www.rain-barrel.net/rainwater-calculator.html>
- Occupancy Calculations By Architectural Building Code
An Architect's guide to building codes & standards /produced by the American Institute of Architects Building. 2nd ed. Washington, D.C.: AIA, c1990.
- Tank Calculation and Cost
<http://www.oasisdesign.net/water/storage/> And by attached excel table.

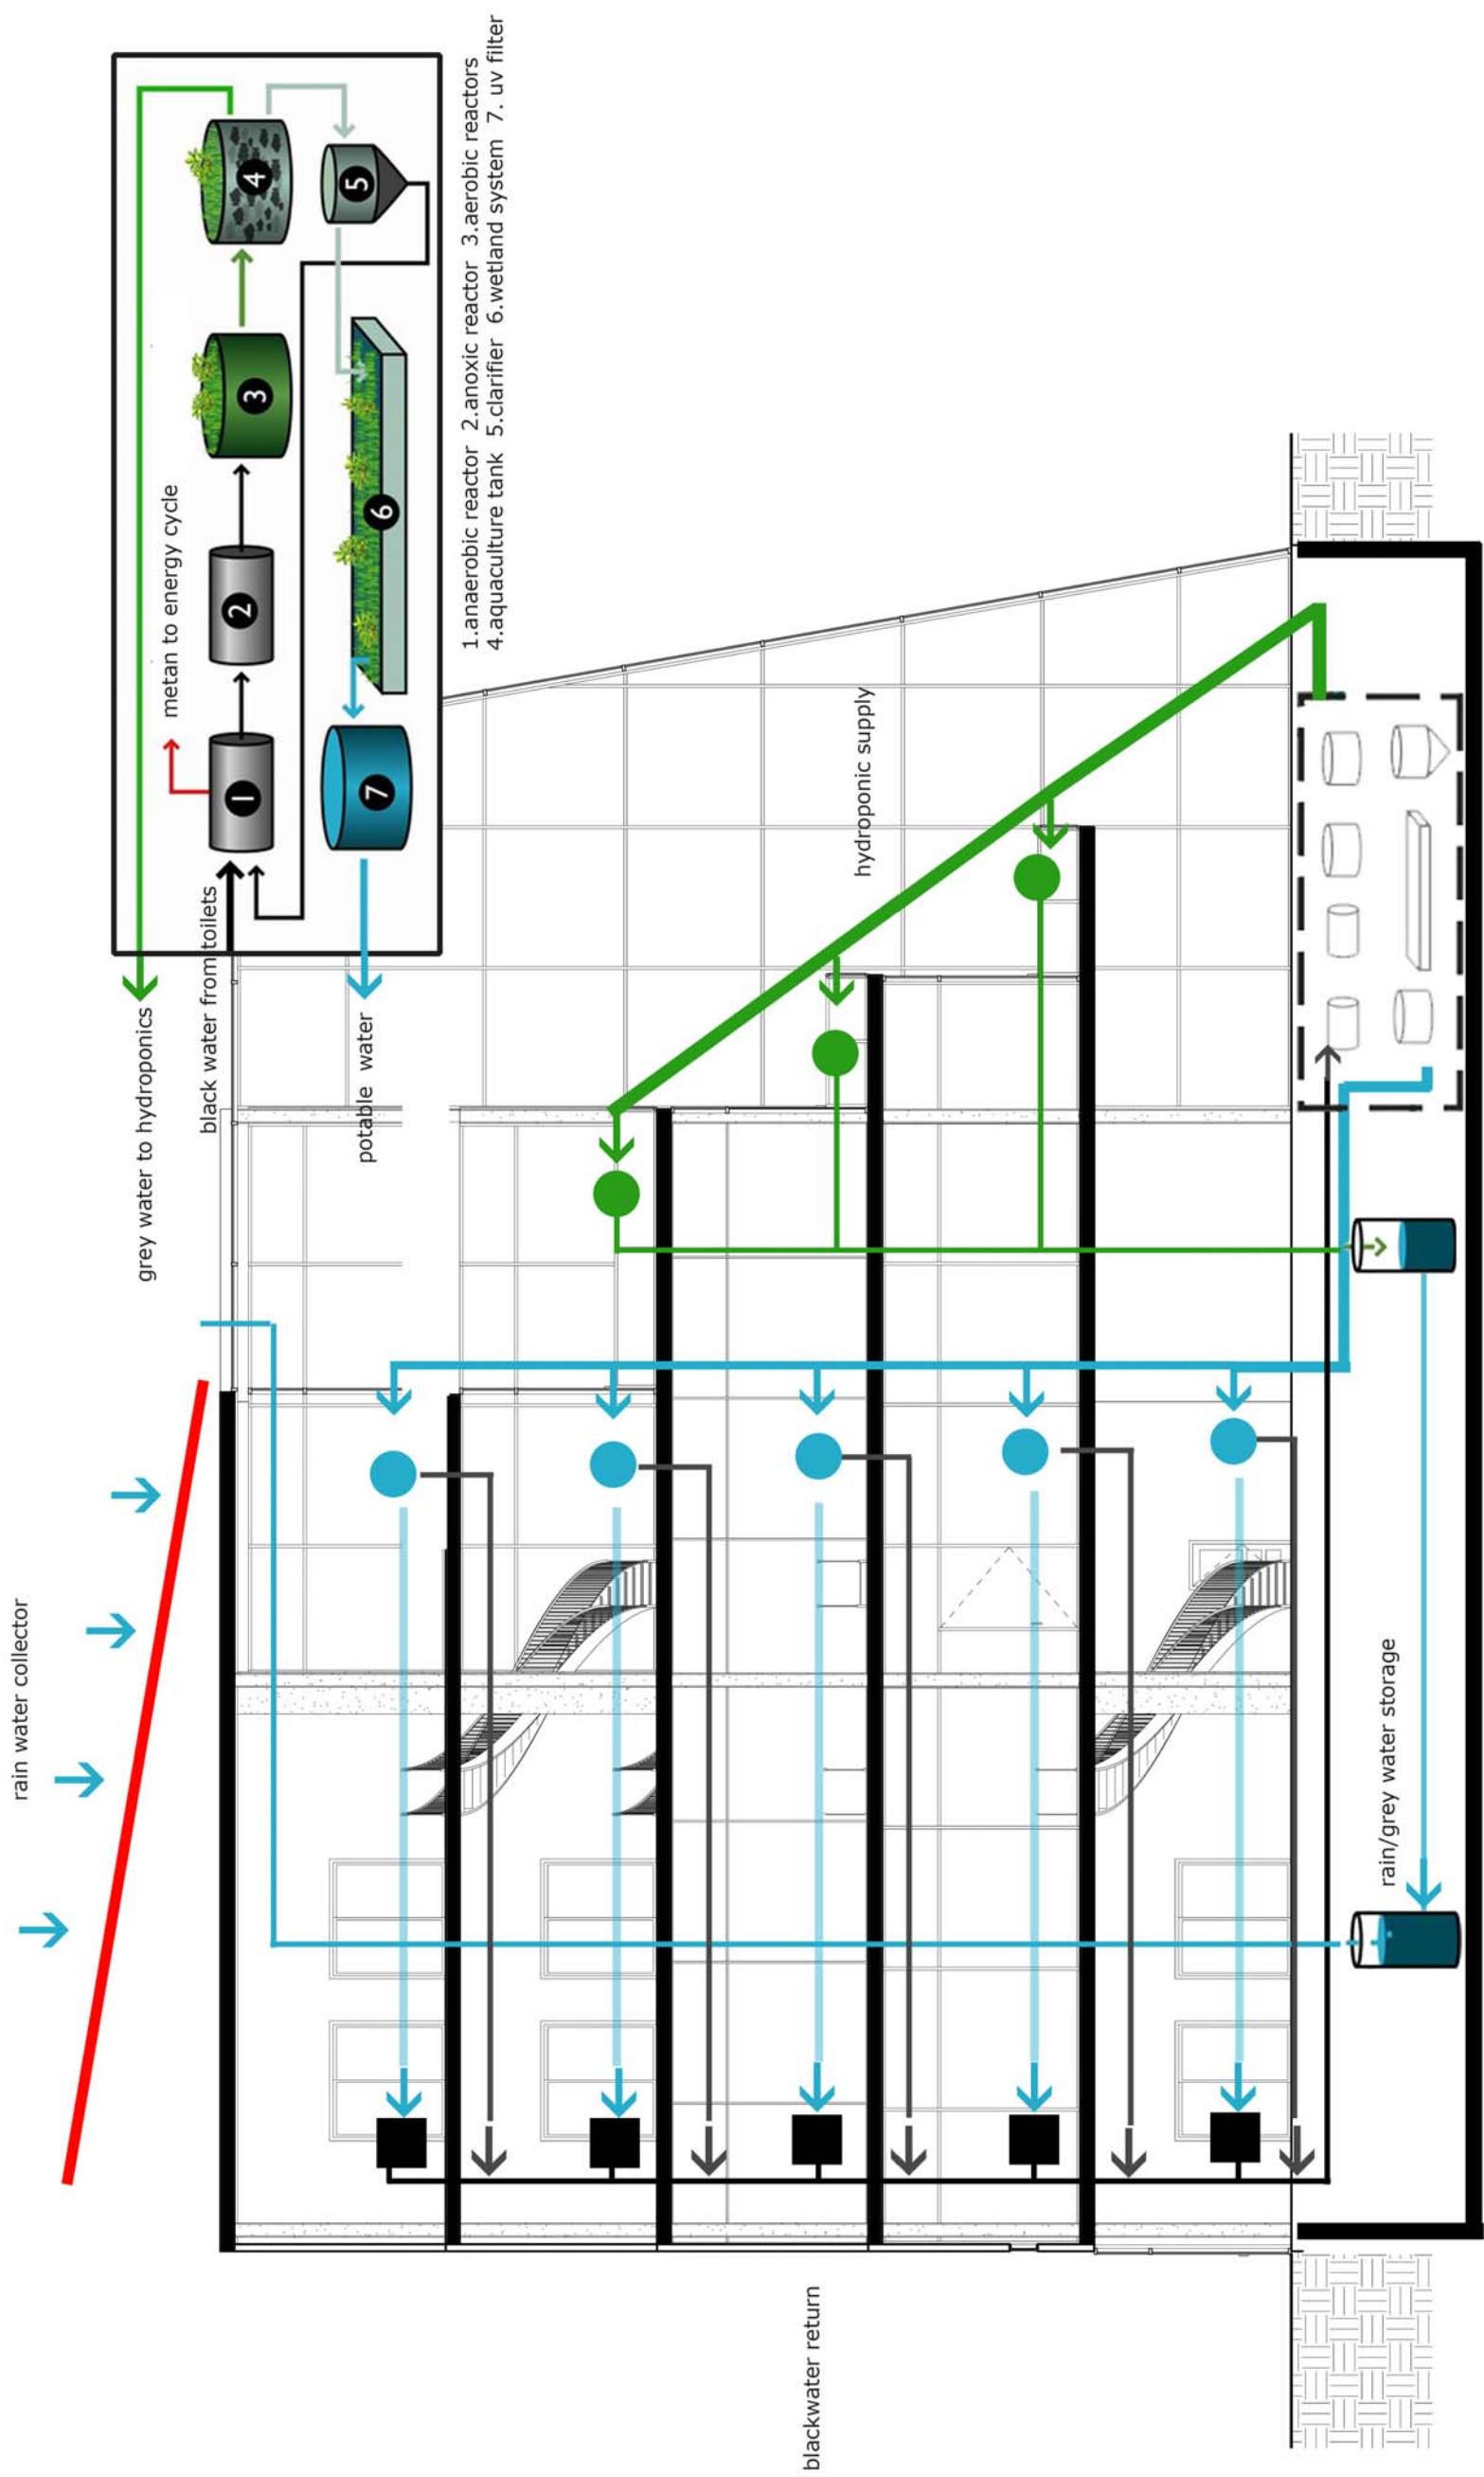

Tank Calculator

A companion to *Water Storage by Art*

Cylindrical tank with domed roof

Given tank dimensions, determine volume and surface area, and amount of material required (for ordering concrete).

Given density of tank material, determine load on ground under tank, and stress on reinforcement.

The table below is set up for ferrocement (See the Water Storage book for description of the construction), steel, and plastic tanks. If you would prefer to specify your own materials and construction specs, use the "Tank Calculator (generic)" worksheet.

Fill in numbers in blue under the in one or more columns. Read calculated values below.

| | Light duty ferrocement | Medium duty ferrocement | Heavy duty ferrocement | Steel | Plastic |
|--|----------------------------|----------------------------|----------------------------|----------------------------|---------------------------|
| Tank volume | 3000.00 gallons | 3000.00 gallons | 3000.00 gallons | 2500.00 gallons | 3000.00 gallons |
| Height | 6.00 feet | 6.00 feet | 6.00 feet | 6.00 feet | 6.00 feet |
| Wall thickness (av) | 1.00 inches | 1.25 inches | 2.00 inches | 0.13 inches | 0.25 inches |
| Roof thickness | 1.00 inches | 1.00 inches | 1.75 inches | 0.13 inches | 0.25 inches |
| Floor thickness | 3.00 inches | 4.00 inches | 5.00 inches | 0.13 inches | 0.25 inches |
| Roof rise/rank diameter | 0.10 ratio | 0.10 ratio | 0.10 ratio | 0.10 ratio | 0.10 ratio |
| Floor beyond walls | 1.00 inches | 3.00 inches | 5.00 inches | 0.00 inches | 0.00 inches |
| Density of material | 100.00 lbs/ft ³ | 100.00 lbs/ft ³ | 100.00 lbs/ft ³ | 300.00 lbs/ft ³ | 60.00 lbs/ft ³ |
| Hoop spacing | 6.00 inches | 18.00 inches | 24.00 inches | N/A | N/A |
| Major reinforcing diameter | 0.13 inches | 0.38 inches | 0.38 inches | N/A | N/A |
| Note that volume under roof below is in ADDITION TO to capacity above. | | | | | |
| Diameter | 9.23 feet | 9.23 feet | 9.23 feet | 8.42 feet | 9.23 feet |
| Diameter/ height | 1.54 ratio | 1.54 ratio | 1.54 ratio | 1.40 ratio | 1.54 ratio |
| Volume | 401.02 Cubic feet | 401.02 Cubic feet | 401.02 Cubic feet | 334.18 Cubic feet | 401.02 Cubic feet |
| Volume under roof | 31.24 Cubic feet | 31.24 Cubic feet | 31.24 Cubic feet | 23.77 Cubic feet | 31.24 Cubic feet |
| Volume under roof | 233.72 Gallons | 233.72 Gallons | 233.72 Gallons | 177.80 Gallons | 233.72 Gallons |
| Total volume | 432.26 Cubic feet | 432.26 Cubic feet | 432.26 Cubic feet | 357.95 Cubic feet | 432.26 Cubic feet |

| | | |
|------------------------------|---------------------------|------------------------|
| Radius | 4.61 Feet | 4.21 Feet |
| Roof rise | 0.92 Feet | 0.84 |
| Circumference | 28.98 Feet | 26.45 Feet |
| Roof area | 66.84 Square feet | 55.70 Square feet |
| Wall area | 173.87 Square feet | 158.72 Square feet |
| Total stucco area | 240.70 Square feet | 214.42 Square feet |
| Floor area | 69.27 Square feet | 55.70 Square feet |
| Total area (cylinder) | 309.98 Square feet | 270.11 |
| | 307.54 Square feet | 270.11 |
| Roof volume | 5.57 Cubic feet | 0.58 Cubic feet |
| Wall volume | 14.49 Cubic feet | 1.65 Cubic feet |
| Total stucco volume | 20.06 Cubic feet | 2.23 Cubic feet |
| Total stucco volume | 0.74 Cubic yards | 0.08 Cubic yards |
| Floor volume | 17.32 Cubic feet | 0.58 Cubic feet |
| Floor volume | 0.64 Cubic yards | 0.02 Cubic yards |
| Total volume | 37.38 Cubic feet | 2.81 Cubic feet |
| Total volume | 1.38 Cubic yard | 0.10 Cubic yard |
| 11.56 ratio | 8.92 ratio | 67.47 ratio |
| Weight of material | 4,843.99 lbs | 7,183.14 lbs |
| Weight of water | 26,969.21 lbs | 26,969.21 lbs |
| Total weight | 30,706.90 lbs | 34,152.36 lbs |
| Force on soil | 3.08 psi | 2.98 psi |
| Force on soil | 443.28 psf | 429.83 psf |
| Max hoop stress | 144.40 psi | 72.20 psi |
| Rebar density | 0.20% % | 0.23% % |
| Max hoop stress rebar alone | 70,615 psi | 31,385 psi |


| | |
|-------------------------------|---------------------|
| Material vol/water vol | 127.22 ratio |
| Weight of material | 844.10 lbs |
| Weight of water | 22,332.82 lbs |
| Total weight | 23,176.92 lbs |
| Force on soil | 2.89 psi |
| Force on soil | 428.31 psf |
| Max hoop stress | 115.52 psi |
| Rebar density | 0.49% % |
| Max hoop stress rebar alone | 23,538 psi |

Comments


Volume excluding space under domed roof
Height of tank walls (not roof height)

Ratio of roof rise to tank diameter. 0 for flat roof, 1/2 diameter for hemisphere
Distance that floor extends beyond walls. Used only to calculate amount of material.
Used to calculate load on ground under tank.
Vertical space between rebar hoops on ferrocement tank. For calculating hoop stress only
Diameter of reinforcing members (rebar hoops for ferrocement tank). For calculating hoop stress only


Energy Model Data:

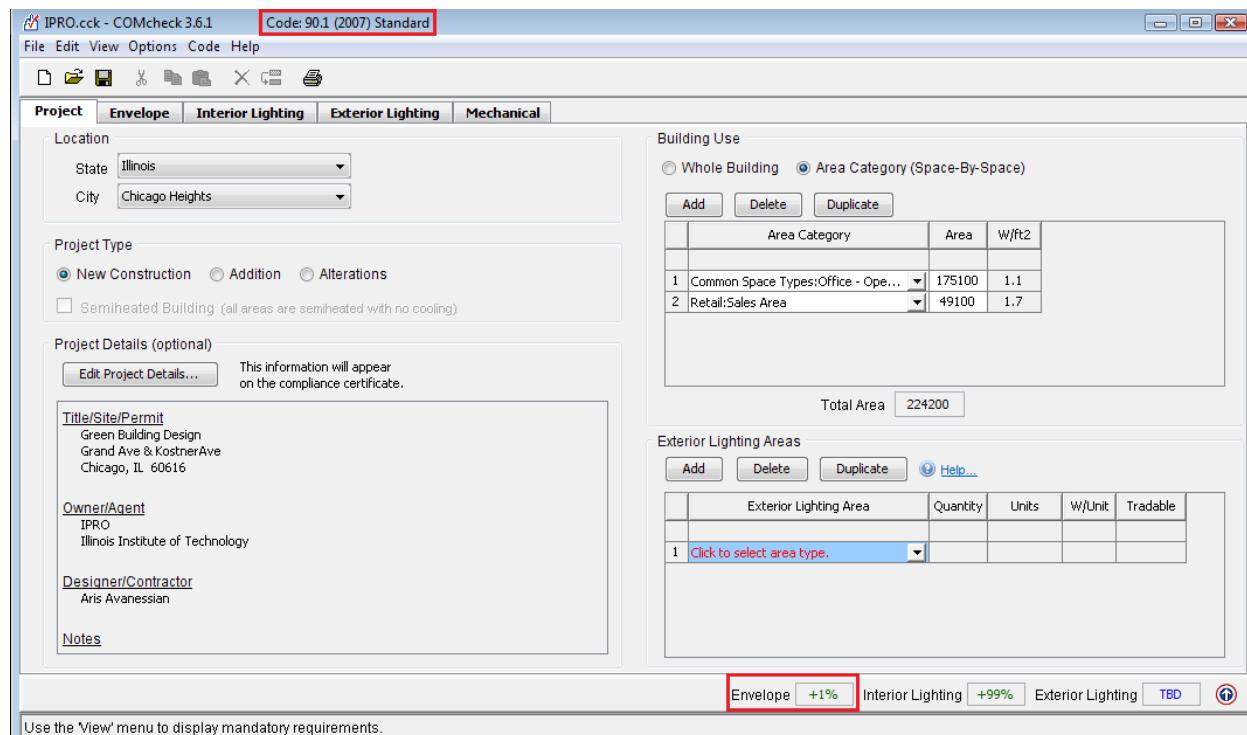

COMCheck Screenshot with ASHRAE 90.1-2007 and Envelope above 1% of code

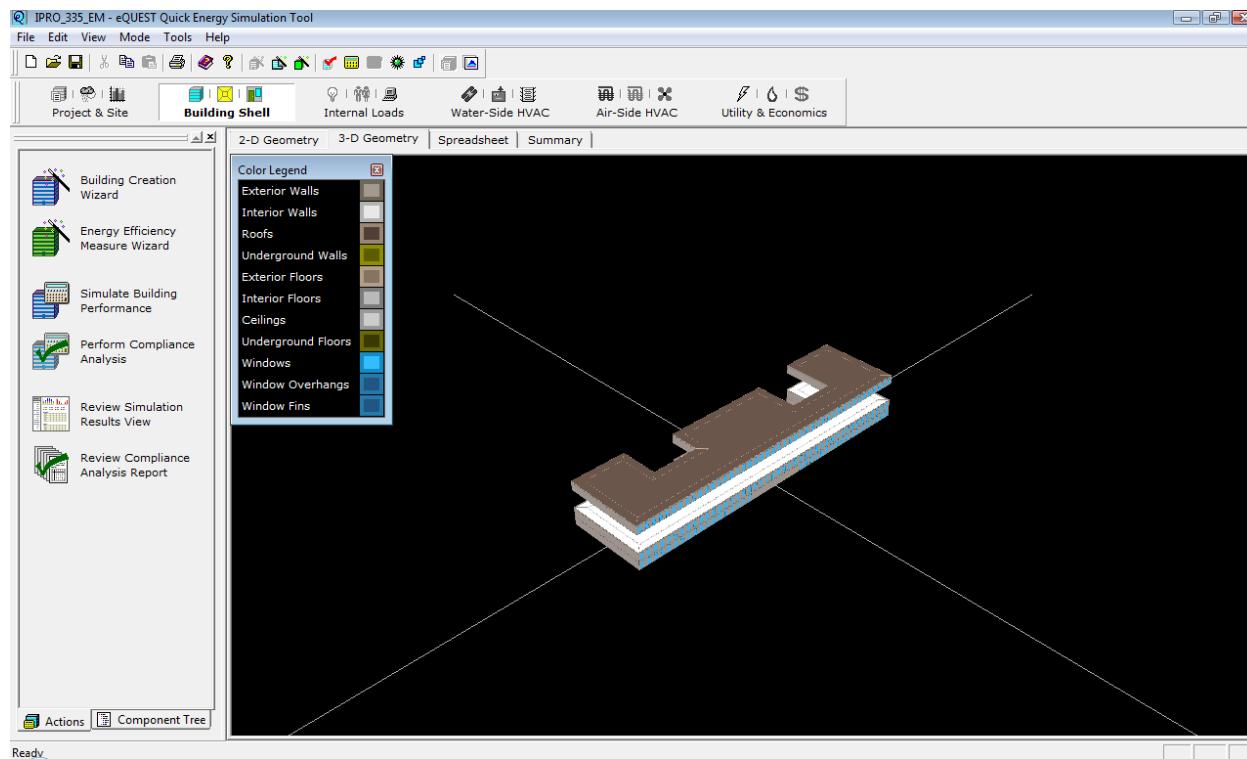


3D rendering of Model in eQuest

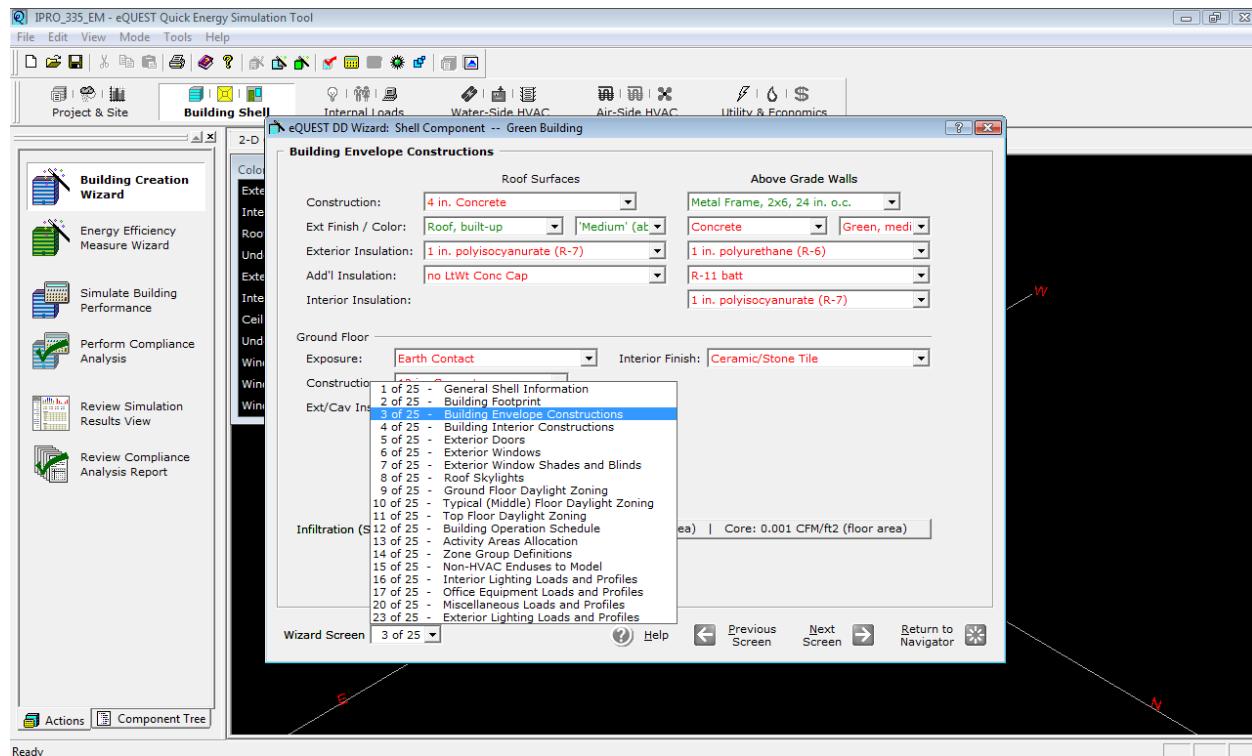


Example of inputs and details of programs input capabilities



Annual Energy Consumption by Enduse

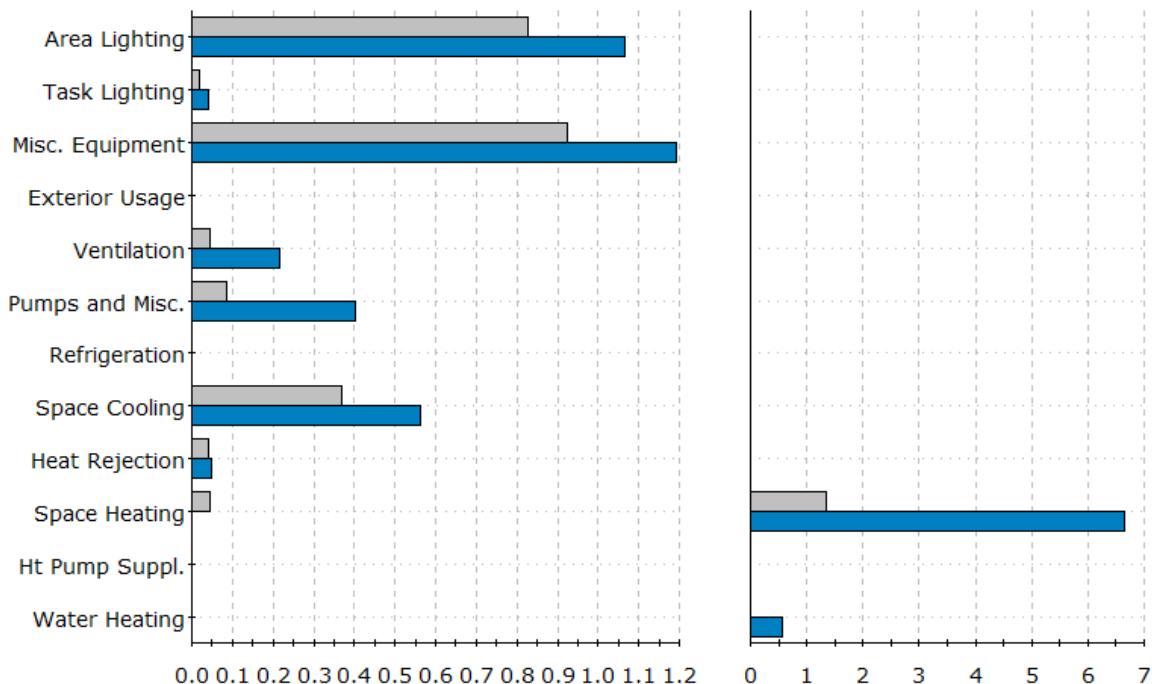

Annual Electric Consumption (kWh)

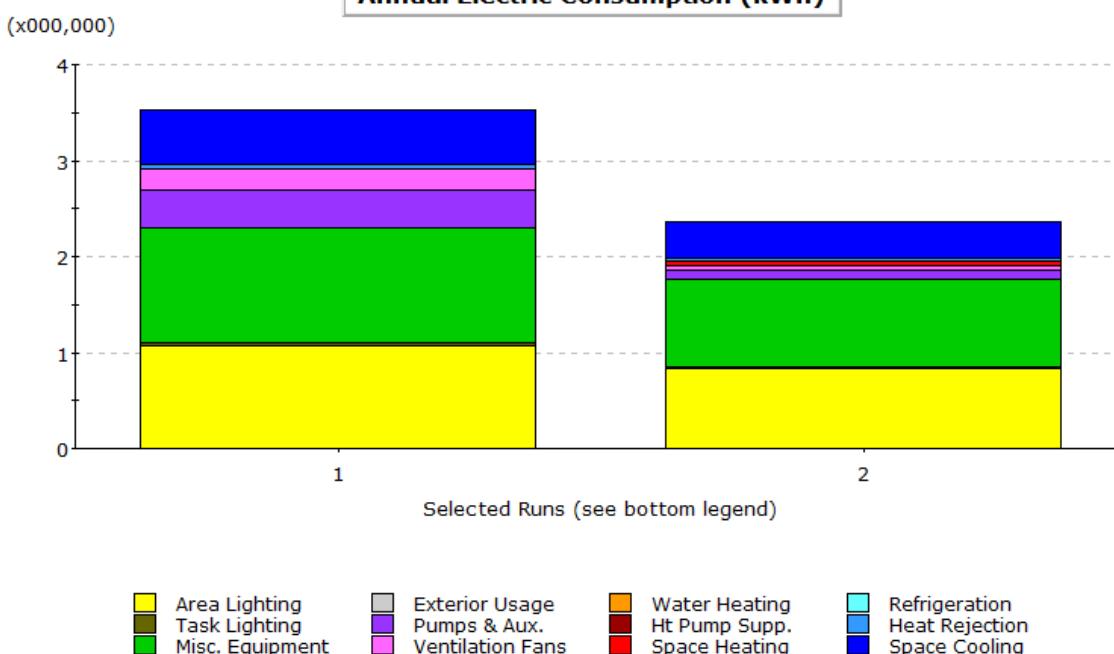

1. IPRO_335_Standard - Standard (11/23/09 @ 19:02)
2. IPRO_335_EM - Energy Efficient (11/23/09 @ 18:24)

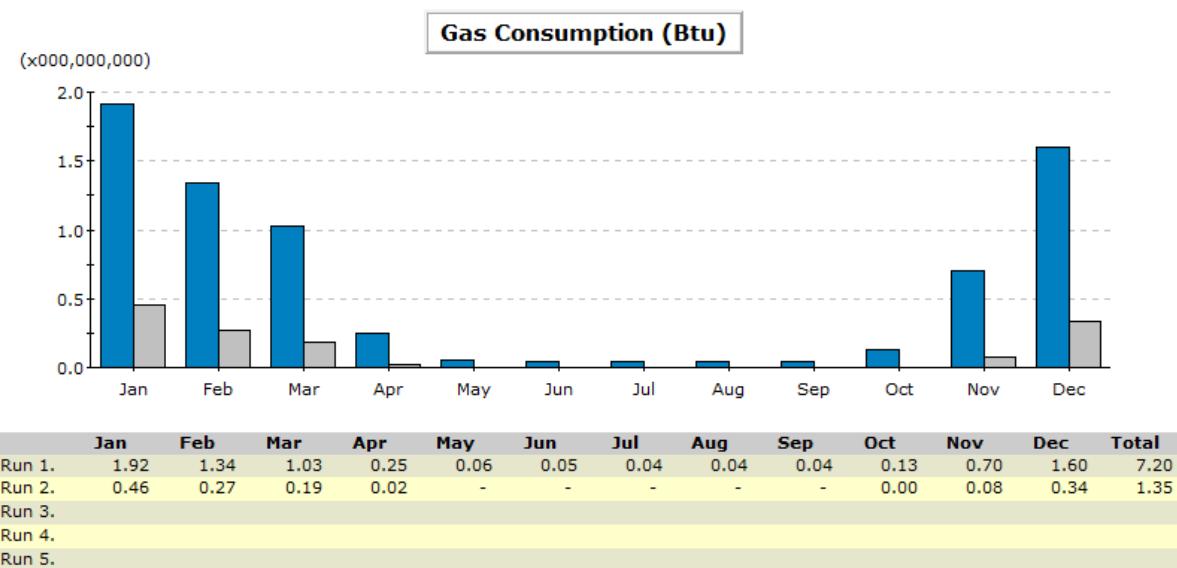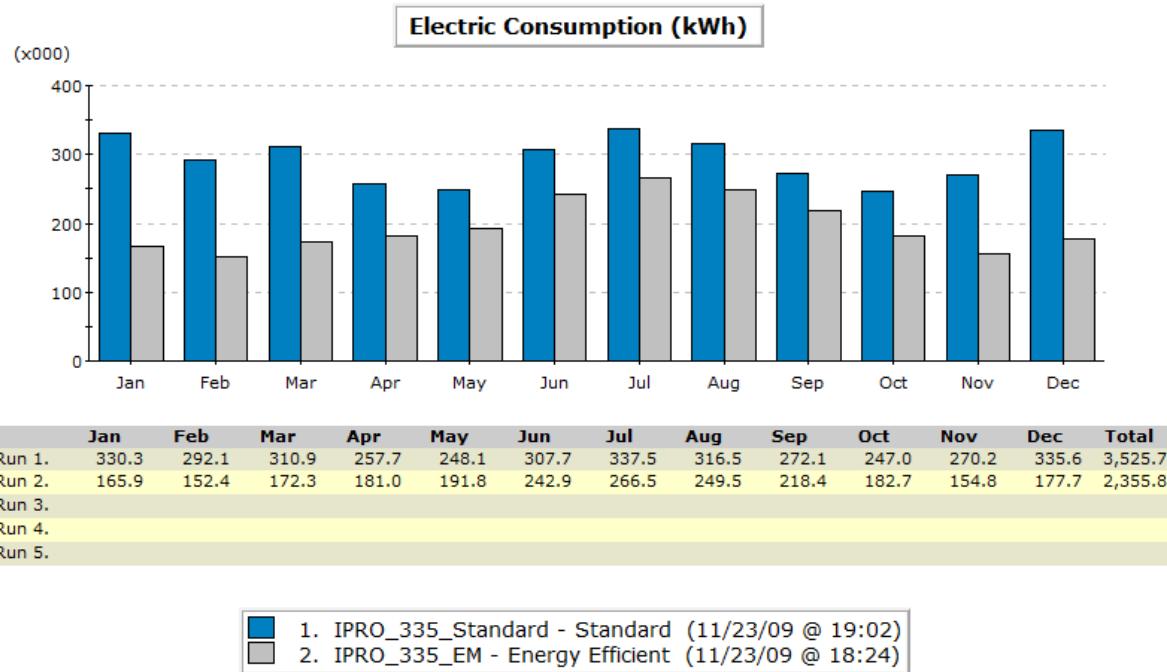

Annual Electric Energy by Enduse (pg 1 of 4)

| | | Ambient Lights | Task Lights | Misc Equip | Space Heating | Space Cooling | Heat Reject | Pumps & Aux | Vent Fans | Dom Ht Wtr | Exterior Usage | Total |
|---|-----------|----------------|---------------|---------------|---------------|---------------|-------------|--------------|------------|----------------|----------------|-------|
| Annual Energy USE (kWh) | | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- | |
| 0 Base Design | 1,064,919 | 35,645 | 1,133,529 | 0 | 561,606 | 47,928 | 401,289 | 216,727 | 0 | 0 | 3,525,743 | |
| 1 0+Standard | | | | | | | | | | | | |
| Annual Energy Coincident Demand (kW) | | Ambient Lights | Task Lights | Misc Equip | Space Heating | Space Cooling | Heat Reject | Pumps & Aux | Vent Fans | Dom Ht Wtr | Exterior Usage | Total |
| 0 Base Design | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- | |
| 1 0+Standard | 323.8 | 14.7 | 327.2 | 0.0 | 513.3 | 79.6 | 87.7 | 63.8 | 0.0 | 0.0 | 1,415.2 | |
| | | | | | | | | | | | | |
| Annual Energy Non-Coincident Demand (kW) | | Ambient Lights | Task Lights | Misc Equip | Space Heating | Space Cooling | Heat Reject | Pumps & Aux | Vent Fans | Dom Ht Wtr | Exterior Usage | Total |
| 0 Base Design | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- | |
| 1 0+Standard | 323.8 | 14.7 | 327.2 | 0.0 | 513.3 | 79.6 | 87.7 | 219.2 | 0.0 | 0.0 | 1,415.2 | |
| | | | | | | | | | | | | |
| Annual Energy USE (MBtu) | | Misc Equip | Space Heating | Space Cooling | Heat Reject | Pumps & Aux | Vent Fans | Ht Pump Supp | Dom Ht Wtr | Exterior Usage | Total | |
| 0 Base Design | -- | 0.0 | 6,635.6 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 563.5 | 0.0 | -- | |
| 1 0+Standard | | | | | | | | | | | 7,200.1 | |

Annual Electric Energy by Enduse (pg 1 of 4)

| | | Ambient Lights | Task Lights | Misc Equip | Space Heating | Space Cooling | Heat Reject | Pumps & Aux | Vent Fans | Dom Ht Wtr | Exterior Usage | Total |
|---|---------|----------------|---------------|---------------|---------------|---------------|-------------|--------------|------------|----------------|----------------|-----------|
| Annual Energy USE (kWh) | | | | | | | | | | | | |
| 0 Base Design | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- |
| 1 0+Energy Efficient | 827,970 | 16,996 | 925,324 | 45,820 | 369,712 | 39,307 | 85,626 | 45,089 | 0 | 0 | 0 | 2,355,839 |
| <hr/> | | | | | | | | | | | | |
| | | Ambient Lights | Task Lights | Misc Equip | Space Heating | Space Cooling | Heat Reject | Pumps & Aux | Vent Fans | Dom Ht Wtr | Exterior Usage | Total |
| Annual Energy Coincident Demand (kW) | | | | | | | | | | | | |
| 0 Base Design | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- |
| 1 0+Energy Efficient | 263.2 | 6.6 | 277.9 | 0.0 | 598.7 | 133.7 | 43.2 | 20.0 | 0.0 | 0.0 | 0.0 | 1,343.4 |
| <hr/> | | | | | | | | | | | | |
| | | Ambient Lights | Task Lights | Misc Equip | Space Heating | Space Cooling | Heat Reject | Pumps & Aux | Vent Fans | Dom Ht Wtr | Exterior Usage | Total |
| Annual Energy Non-Coincident Demand (kW) | | | | | | | | | | | | |
| 0 Base Design | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- |
| 1 0+Energy Efficient | 291.4 | 6.6 | 277.9 | 125.4 | 598.7 | 141.6 | 43.2 | 20.0 | 0.0 | 0.0 | 0.0 | 1,343.4 |
| <hr/> | | | | | | | | | | | | |
| | | Misc Equip | Space Heating | Space Cooling | Heat Reject | Pumps & Aux | Vent Fans | Ht Pump Supp | Dom Ht Wtr | Exterior Usage | Total | |
| Annual Energy USE (MBtu) | | | | | | | | | | | | |
| 0 Base Design | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- |
| 1 0+Energy Efficient | 0.0 | 1,347.8 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 1,347.8 |

LEED Checklist:



LEED 2009 for New Construction and Major Renovation Project Scorecard

Project Name: IPRO 335

Project Address:

Yes

?

No

| | | |
|----|-------------------|-----------|
| 21 | SUSTAINABLE SITES | 26 Points |
|----|-------------------|-----------|

| | | | |
|---|------------|---|----------|
| Y | Prereq 1 | Construction Activity Pollution Prevention | Required |
| 1 | Credit 1 | Site Selection | 1 |
| 5 | Credit 2 | Development Density and Community Connectivity | 5 |
| 1 | Credit 3 | Brownfield Redevelopment | 1 |
| 6 | Credit 4.1 | Alternative Transportation - Public Transportation Access | 6 |
| 1 | Credit 4.2 | Alternative Transportation - Bicycle Storage and Changing Rooms | 1 |
| 3 | Credit 4.3 | Alternative Transportation - Low-Emitting and Fuel-Efficient Vehicles | 3 |
| 2 | Credit 4.4 | Alternative Transportation - Parking Capacity | 2 |
| 1 | Credit 5.1 | Site Development - Protect or Restore Habitat | 1 |
| 1 | Credit 5.2 | Site Development - Maximize Open Space | 1 |
| 1 | Credit 6.1 | Stormwater Design - Quantity Control | 1 |
| 1 | Credit 6.2 | Stormwater Design - Quality Control | 1 |
| 1 | Credit 7.1 | Heat Island Effect - Nonroof | 1 |
| 1 | Credit 7.2 | Heat Island Effect - Roof | 1 |
| 1 | Credit 8 | Light Pollution Reduction | 1 |

| | | | | |
|-----|---|----|------------------|-----------|
| Yes | ? | No | WATER EFFICIENCY | 10 Points |
|-----|---|----|------------------|-----------|

| | | | |
|---|----------|------------------------------------|----------|
| Y | Prereq 1 | Water Use Reduction | Required |
| 2 | Credit 1 | Water Efficient Landscaping | 2 to 4 |
| 2 | Credit 2 | Reduce by 50% | 2 |
| 2 | Credit 3 | No Potable Water Use or Irrigation | 4 |
| 2 | Credit 2 | Innovative Wastewater Technologies | 2 |
| 2 | Credit 3 | Water Use Reduction | 2 to 4 |
| 2 | Credit 2 | Reduce by 30% | 2 |
| 2 | Credit 3 | Reduce by 35% | 3 |
| 2 | Credit 2 | Reduce by 40% | 4 |

| | | |
|----|---------------------|-----------|
| 34 | ENERGY & ATMOSPHERE | 35 Points |
|----|---------------------|-----------|

| | | | |
|----|-----------|---|----------|
| Y | Prereq 1 | Fundamental Commissioning of Building Energy Systems | Required |
| Y | Prereq 2 | Minimum Energy Performance | Required |
| Y | Prereq 3 | Fundamental Refrigerant Management | Required |
| 18 | Credit 1 | Optimize Energy Performance | 1 to 19 |
| 18 | Credit 2 | Improve by 12% for New Buildings or 8% for Existing Building Renovations | 1 |
| 18 | Credit 3 | Improve by 14% for New Buildings or 10% for Existing Building Renovations | 2 |
| 18 | Credit 4 | Improve by 16% for New Buildings or 12% for Existing Building Renovations | 3 |
| 18 | Credit 5 | Improve by 18% for New Buildings or 14% for Existing Building Renovations | 4 |
| 18 | Credit 6 | Improve by 20% for New Buildings or 16% for Existing Building Renovations | 5 |
| 18 | Credit 7 | Improve by 22% for New Buildings or 18% for Existing Building Renovations | 6 |
| 18 | Credit 8 | Improve by 24% for New Buildings or 20% for Existing Building Renovations | 7 |
| 18 | Credit 9 | Improve by 26% for New Buildings or 22% for Existing Building Renovations | 8 |
| 18 | Credit 10 | Improve by 28% for New Buildings or 24% for Existing Building Renovations | 9 |
| 18 | Credit 11 | Improve by 30% for New Buildings or 26% for Existing Building Renovations | 10 |
| 18 | Credit 12 | Improve by 32% for New Buildings or 28% for Existing Building Renovations | 11 |
| 18 | Credit 13 | Improve by 34% for New Buildings or 30% for Existing Building Renovations | 12 |
| 18 | Credit 14 | Improve by 36% for New Buildings or 32% for Existing Building Renovations | 13 |
| 18 | Credit 15 | Improve by 38% for New Buildings or 34% for Existing Building Renovations | 14 |
| 18 | Credit 16 | Improve by 40% for New Buildings or 36% for Existing Building Renovations | 15 |
| 18 | Credit 17 | Improve by 42% for New Buildings or 38% for Existing Building Renovations | 16 |
| 18 | Credit 18 | Improve by 44% for New Buildings or 40% for Existing Building Renovations | 17 |
| 18 | Credit 19 | Improve by 46% for New Buildings or 42% for Existing Building Renovations | 18 |
| 18 | Credit 20 | Improve by 48%+ for New Buildings or 44%+ for Existing Building Renovations | 19 |
| 7 | Credit 21 | On-Site Renewable Energy | 1 to 7 |
| 7 | Credit 22 | 1% Renewable Energy | 1 |
| 7 | Credit 23 | 3% Renewable Energy | 2 |
| 7 | Credit 24 | 5% Renewable Energy | 3 |
| 7 | Credit 25 | 7% Renewable Energy | 4 |
| 7 | Credit 26 | 9% Renewable Energy | 5 |
| 7 | Credit 27 | 11% Renewable Energy | 6 |
| 7 | Credit 28 | 13% Renewable Energy | 7 |
| 2 | Credit 29 | Enhanced Commissioning | 2 |
| 2 | Credit 30 | Enhanced Refrigerant Management | 2 |
| 3 | Credit 31 | Measurement and Verification | 3 |
| 2 | Credit 32 | Green Power | 2 |



LEED 2009 for New Construction and Major Renovation Project Scorecard

Project Name: IPRO 335

Project Address:

Yes ? No
Yes ? No

5 MATERIALS & RESOURCES 14 Points

| | | | |
|-------------------------------------|------------|---|----------|
| <input checked="" type="checkbox"/> | Prereq 1 | Storage and Collection of Recyclables | Required |
| <input checked="" type="checkbox"/> | Credit 1.1 | Building Reuse - Maintain Existing Walls, Floors and Roof | 1 to 3 |
| <input checked="" type="checkbox"/> | | Reuse 55% | 1 |
| <input checked="" type="checkbox"/> | | Reuse 75% | 2 |
| <input checked="" type="checkbox"/> | | Reuse 95% | 3 |
| <input checked="" type="checkbox"/> | Credit 1.2 | Building Reuse - Maintain Interior Nonstructural Elements | 1 |
| <input checked="" type="checkbox"/> | Credit 2 | Construction Waste Management | 1 to 2 |
| <input checked="" type="checkbox"/> | | 50% Recycled or Salvaged | 1 |
| <input checked="" type="checkbox"/> | | 75% Recycled or Salvaged | 2 |
| <input checked="" type="checkbox"/> | Credit 3 | Materials Reuse | 1 to 2 |
| <input checked="" type="checkbox"/> | | Reuse 5% | 1 |
| <input checked="" type="checkbox"/> | | Reuse 10% | 2 |
| <input checked="" type="checkbox"/> | Credit 4 | Recycled Content | 1 to 2 |
| <input checked="" type="checkbox"/> | | 10% of Content | 1 |
| <input checked="" type="checkbox"/> | | 20% of Content | 2 |
| <input checked="" type="checkbox"/> | Credit 5 | Regional Materials | 1 to 2 |
| <input checked="" type="checkbox"/> | | 10% of Materials | 1 |
| <input checked="" type="checkbox"/> | | 20% of Materials | 2 |
| <input checked="" type="checkbox"/> | Credit 6 | Rapidly Renewable Materials | 1 |
| <input checked="" type="checkbox"/> | Credit 7 | Certified Wood | 1 |

15 INDOOR ENVIRONMENTAL QUALITY 15 Points

| | | | |
|-------------------------------------|------------|---|----------|
| <input checked="" type="checkbox"/> | Prereq 1 | Minimum Indoor Air Quality Performance | Required |
| <input checked="" type="checkbox"/> | Prereq 2 | Environmental Tobacco Smoke (ETS) Control | Required |
| <input checked="" type="checkbox"/> | Credit 1 | Outdoor Air Delivery Monitoring | 1 |
| <input checked="" type="checkbox"/> | Credit 2 | Increased Ventilation | 1 |
| <input checked="" type="checkbox"/> | Credit 3.1 | Construction Indoor Air Quality Management Plan - During Construction | 1 |
| <input checked="" type="checkbox"/> | Credit 3.2 | Construction Indoor Air Quality Management Plan - Before Occupancy | 1 |
| <input checked="" type="checkbox"/> | Credit 4.1 | Low-Emitting Materials - Adhesives and Sealants | 1 |
| <input checked="" type="checkbox"/> | Credit 4.2 | Low-Emitting Materials - Paints and Coatings | 1 |
| <input checked="" type="checkbox"/> | Credit 4.3 | Low-Emitting Materials - Flooring Systems | 1 |
| <input checked="" type="checkbox"/> | Credit 4.4 | Low-Emitting Materials - Composite Wood and Agrifiber Products | 1 |
| <input checked="" type="checkbox"/> | Credit 5 | Indoor Chemical and Pollutant Source Control | 1 |
| <input checked="" type="checkbox"/> | Credit 6.1 | Controllability of Systems - Lighting | 1 |
| <input checked="" type="checkbox"/> | Credit 6.2 | Controllability of Systems - Thermal Comfort | 1 |
| <input checked="" type="checkbox"/> | Credit 7.1 | Thermal Comfort - Design | 1 |
| <input checked="" type="checkbox"/> | Credit 7.2 | Thermal Comfort - Verification | 1 |
| <input checked="" type="checkbox"/> | Credit 8.1 | Daylight and Views - Daylight | 1 |
| <input checked="" type="checkbox"/> | Credit 8.2 | Daylight and Views - Views | 1 |

1 INNOVATION IN DESIGN 6 Points

| | | | |
|-------------------------------------|----------|-------------------------------------|--------|
| <input checked="" type="checkbox"/> | Credit 1 | Innovation in Design | 1 to 5 |
| <input checked="" type="checkbox"/> | | Innovation or Exemplary Performance | 1 |
| <input checked="" type="checkbox"/> | | Innovation or Exemplary Performance | 1 |
| <input checked="" type="checkbox"/> | | Innovation or Exemplary Performance | 1 |
| <input checked="" type="checkbox"/> | | Innovation | 1 |
| <input checked="" type="checkbox"/> | | Innovation | 1 |
| <input checked="" type="checkbox"/> | Credit 2 | LEED® Accredited Professional | 1 |

1 REGIONAL PRIORITY 4 Points

| | | | |
|-------------------------------------|----------|------------------------------------|--------|
| <input checked="" type="checkbox"/> | Credit 1 | Regional Priority | 1 to 4 |
| <input checked="" type="checkbox"/> | | Regionally Defined Credit Achieved | 1 |
| <input checked="" type="checkbox"/> | | Regionally Defined Credit Achieved | 1 |
| <input checked="" type="checkbox"/> | | Regionally Defined Credit Achieved | 1 |
| <input checked="" type="checkbox"/> | | Regionally Defined Credit Achieved | 1 |

82 PROJECT TOTALS (Certification Estimates) 110 Points

Certified: 40-49 points Silver: 50-59 points Gold: 60-79 points Platinum: 80+ points